


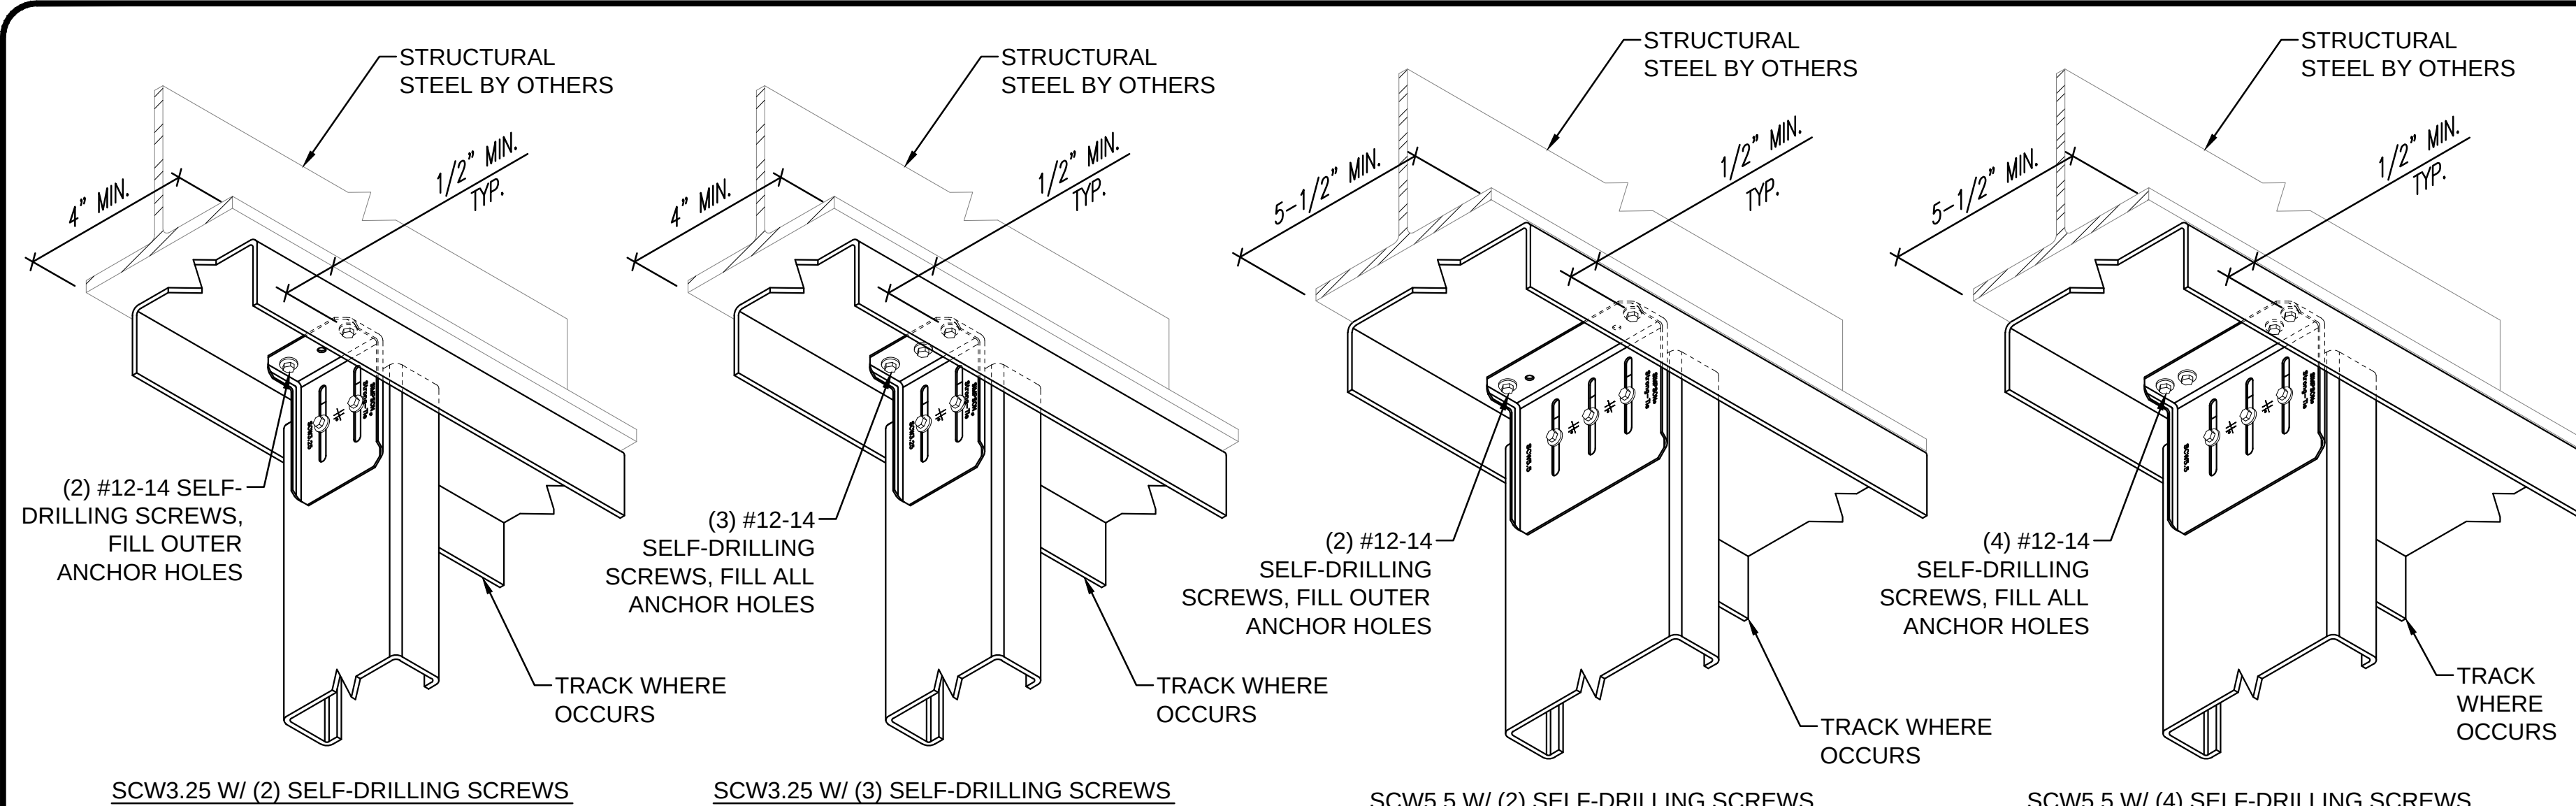


SCW3.25 W/ (2) SELF-DRILLING SCREWS

SCW3.25 W/ (3) SELF-DRILLING SCREWS

SCW5.5 W/ (2) SELF-DRILLING SCREWS

SCW5.5 W/ (4) SELF-DRILLING SCREWS

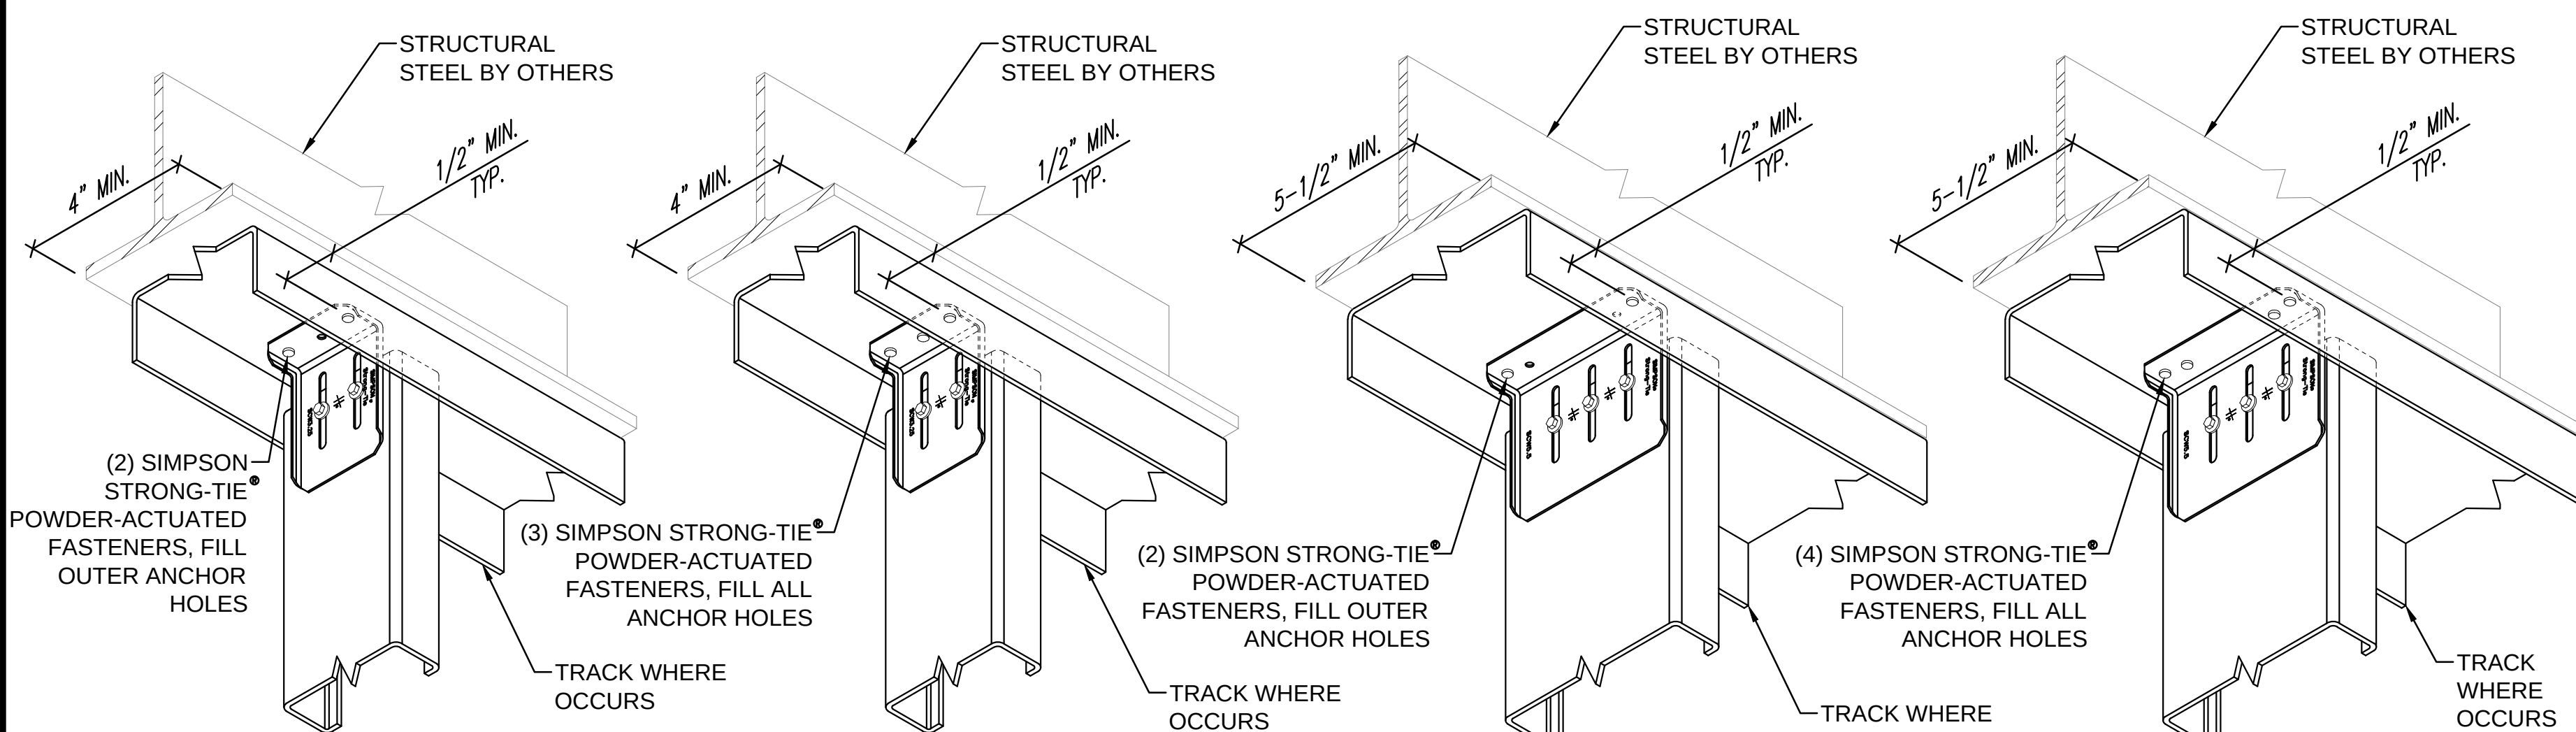

SCW3.25 W/ (2) POWDER-ACTUATED FASTENERS

SCW3.25 W/ (3) POWDER-ACTUATED FASTENERS


SCW5.5 W/ (2) POWDER-ACTUATED FASTENERS

SCW5.5 W/ (4) POWDER-ACTUATED FASTENERS

- NOTES:**
- 1.) INSTALLATION IS BASED ON A MINIMUM 3/16" THICK STRUCTURAL STEEL WITH Fy = 36 KSI.
 - 2.) ACCEPTABLE POWDER-ACTUATED FASTENERS INCLUDE THE FOLLOWING:
 - SIMPSON STRONG-TIE® 0.145" PDPT
 - SIMPSON STRONG-TIE® 0.157" PDPAT
 - 3.) INSTALLATION REQUIRES FULL BEARING OF THE ANCHOR LEG ON THE SUPPORTING STRUCTURE.

SCW HEAD-OF-WALL SLIDE CLIP ANCHORAGE TO STEEL


3

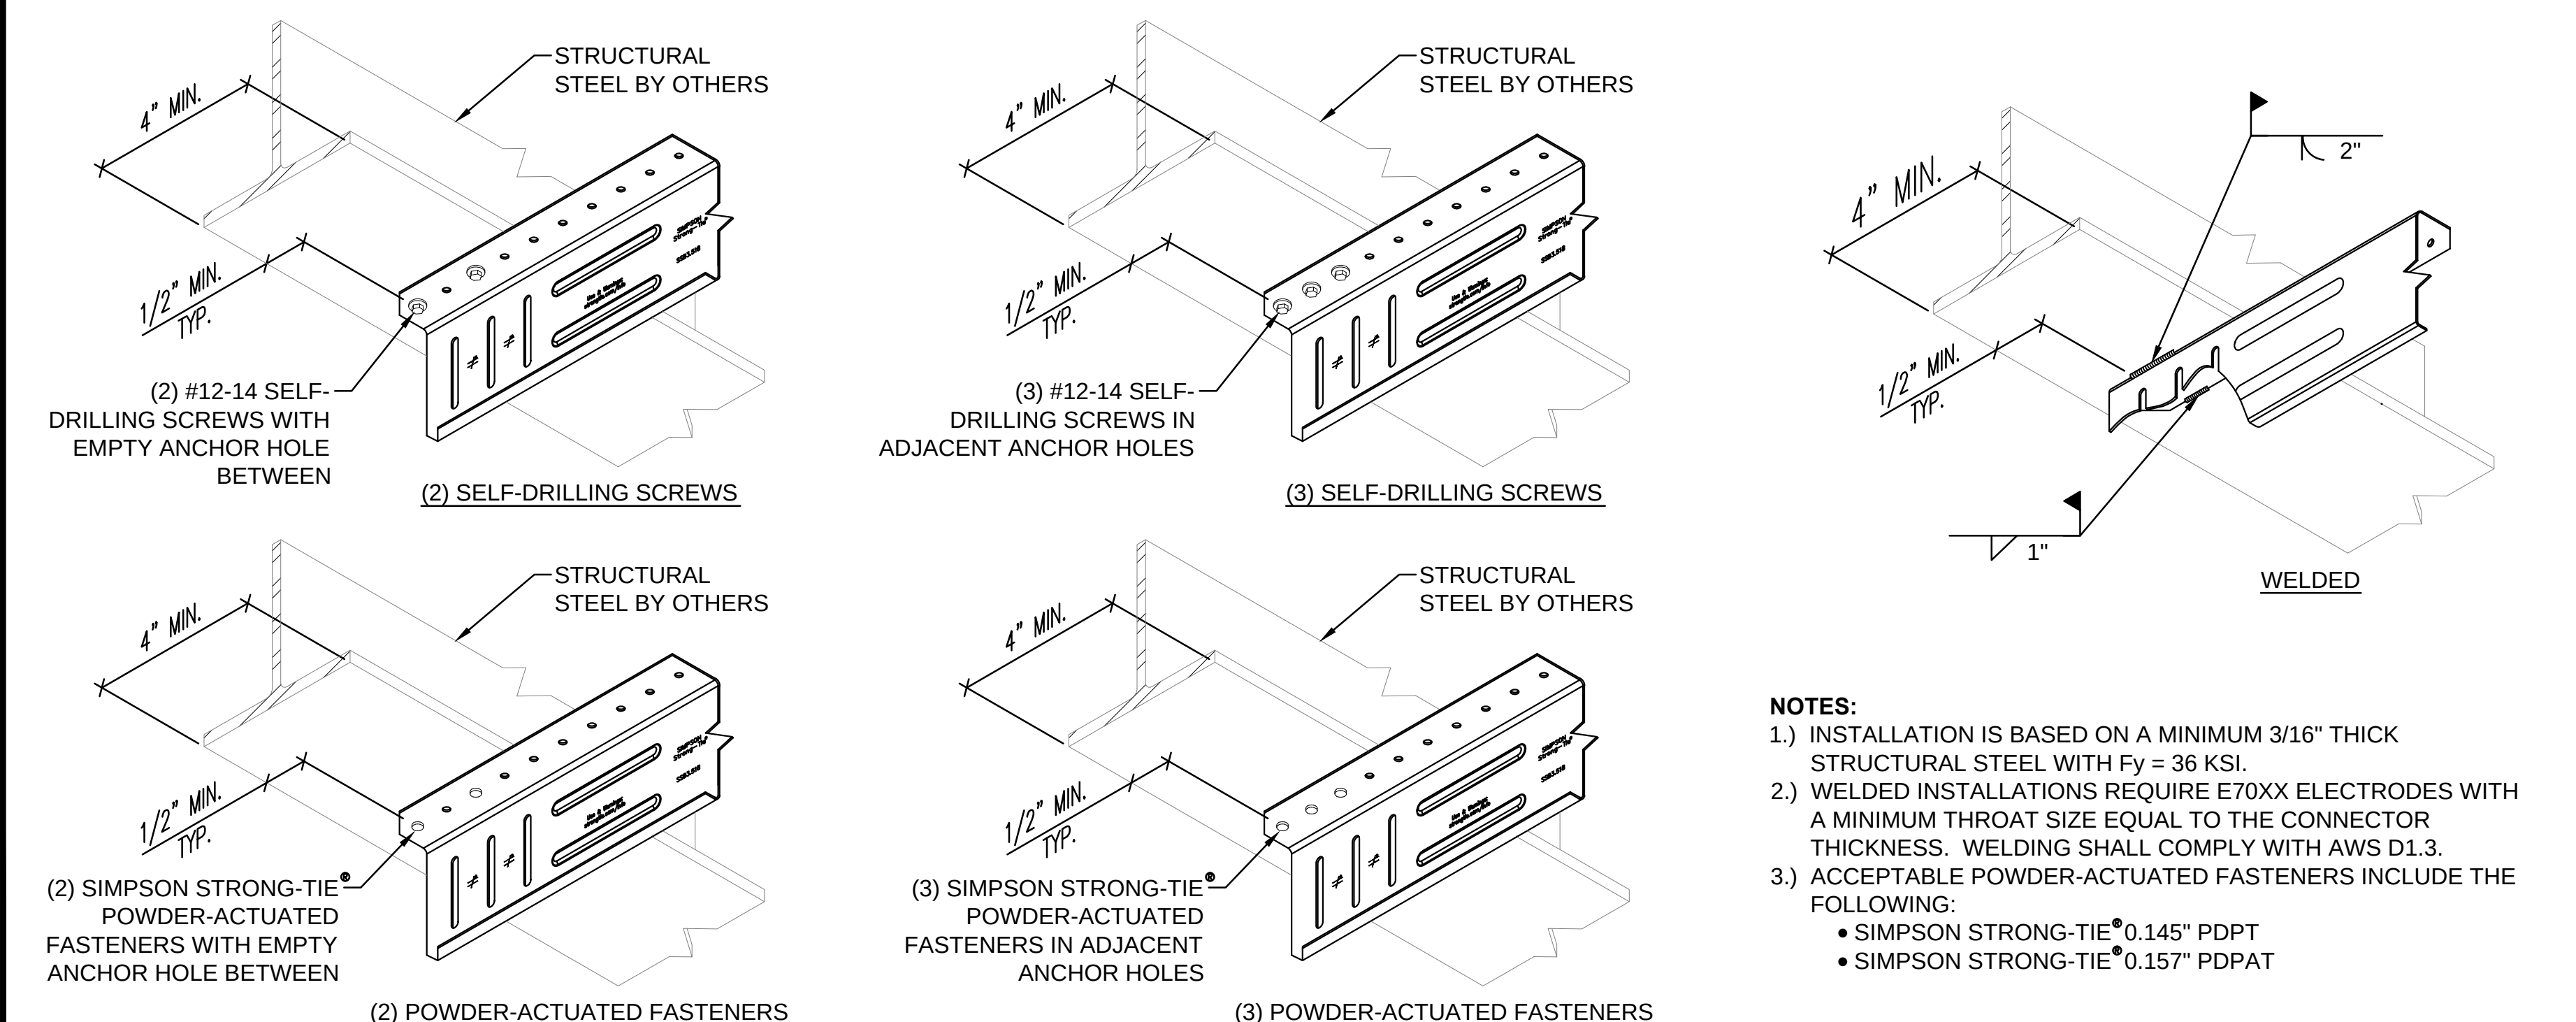


- NOTES:**
- 1.) INSTALLATION IS BASED ON A MINIMUM 3/16" THICK STRUCTURAL STEEL WITH Fy = 36 KSI.
 - 2.) WELDED INSTALLATIONS REQUIRE E70XX ELECTRODES WITH A MINIMUM THROAT SIZE EQUAL TO THE CONNECTOR THICKNESS. WELDING SHALL COMPLY WITH AWS D1.3.
 - 3.) ACCEPTABLE POWDER-ACTUATED FASTENERS INCLUDE THE FOLLOWING:
 - SIMPSON STRONG-TIE® 0.145" PDPT
 - SIMPSON STRONG-TIE® 0.157" PDPAT

SSB BYPASS SLIDE CLIP STRUT ANCHORAGE TO STEEL


4

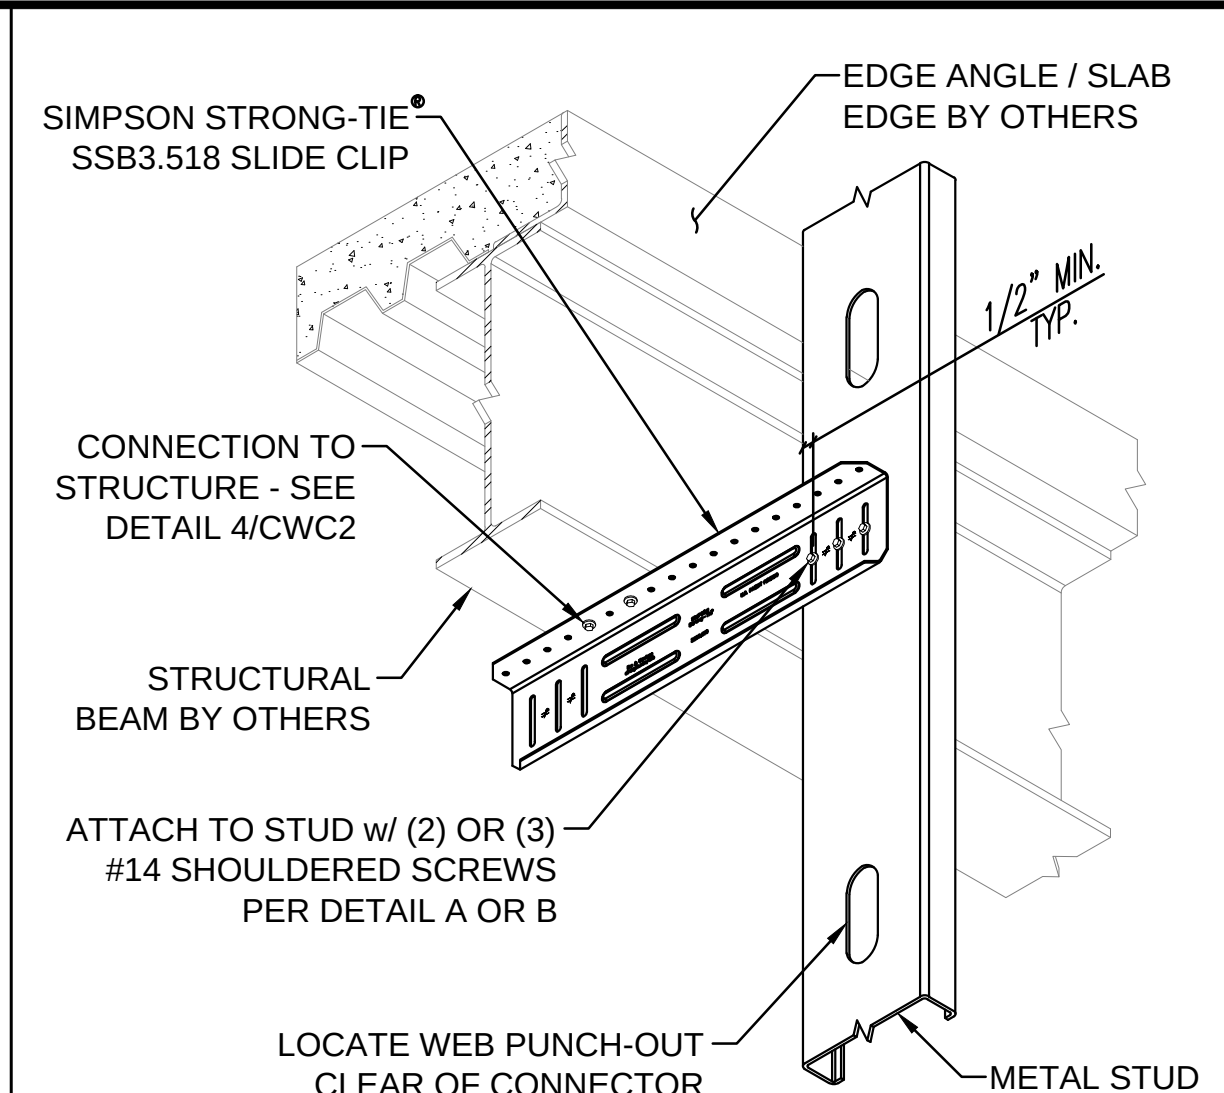


C SSB3.518 W/ REDUCED STANDOFF

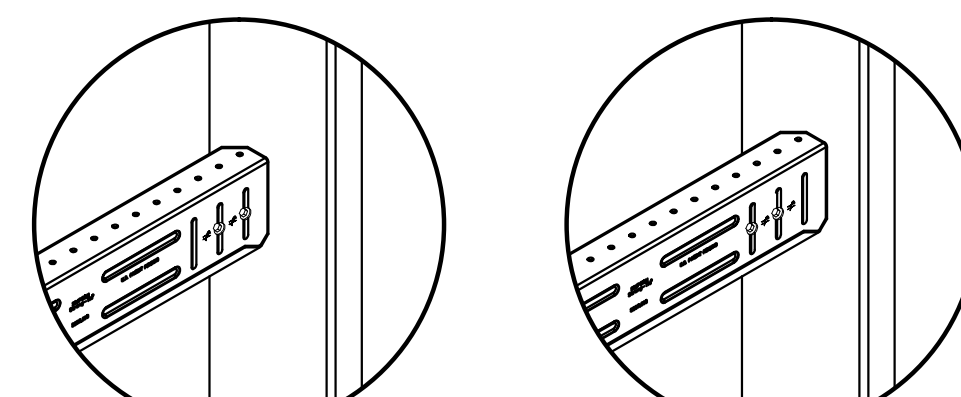

ALTERNATE SHOULDERED SCREW PLACEMENT

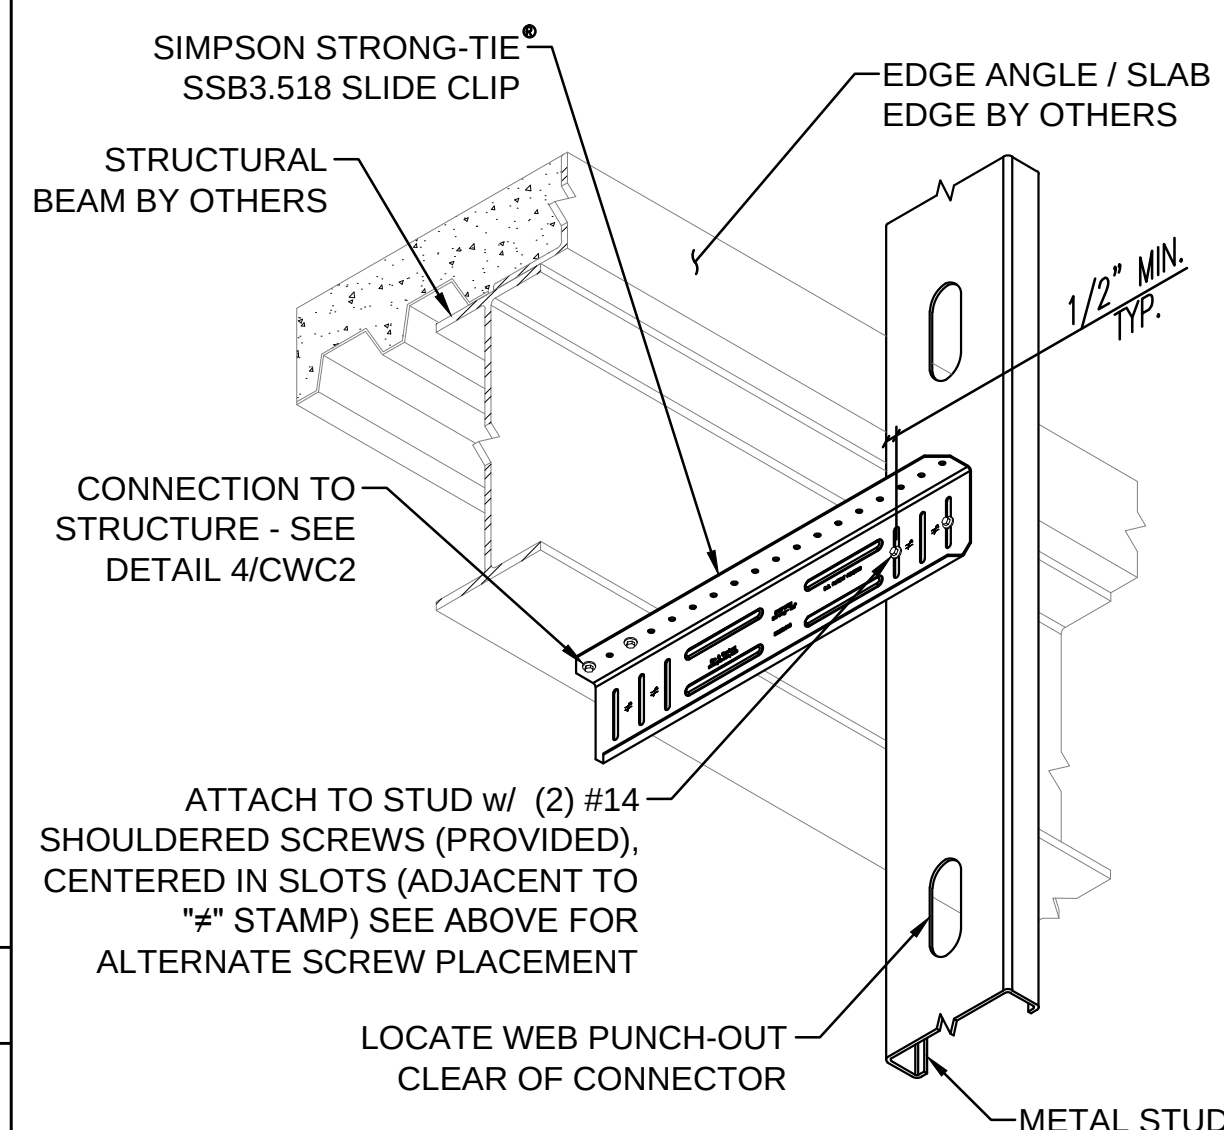


B SSB3.518 W/ (2) SCREWS

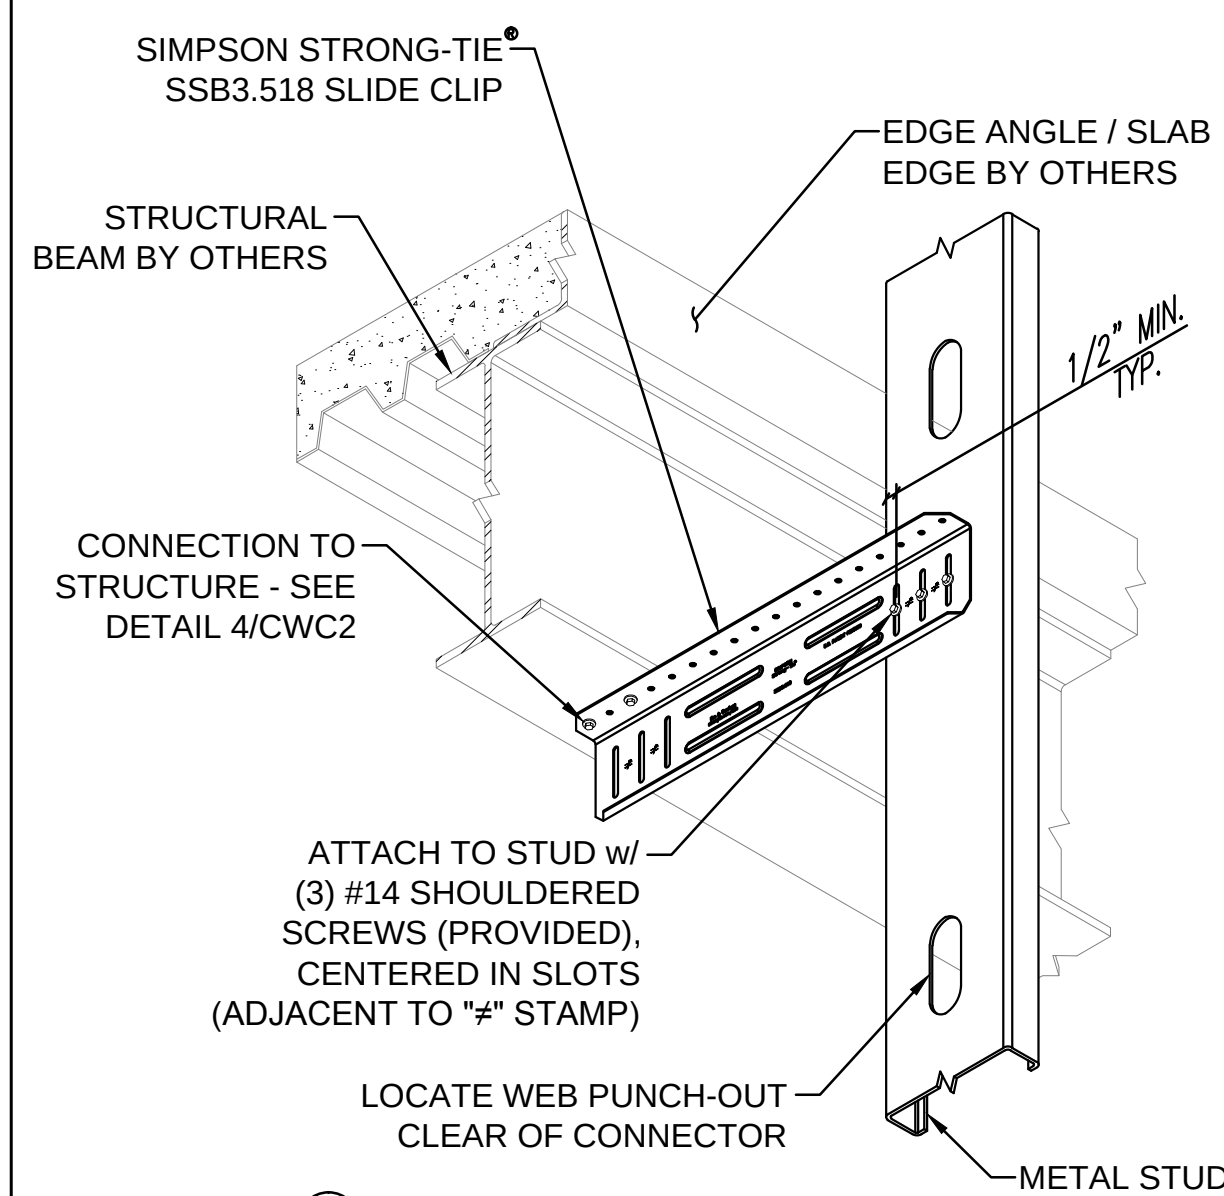


A SSB3.518 W/ (3) SCREWS

SSB BYPASS SLIDE CLIP STRUT


2

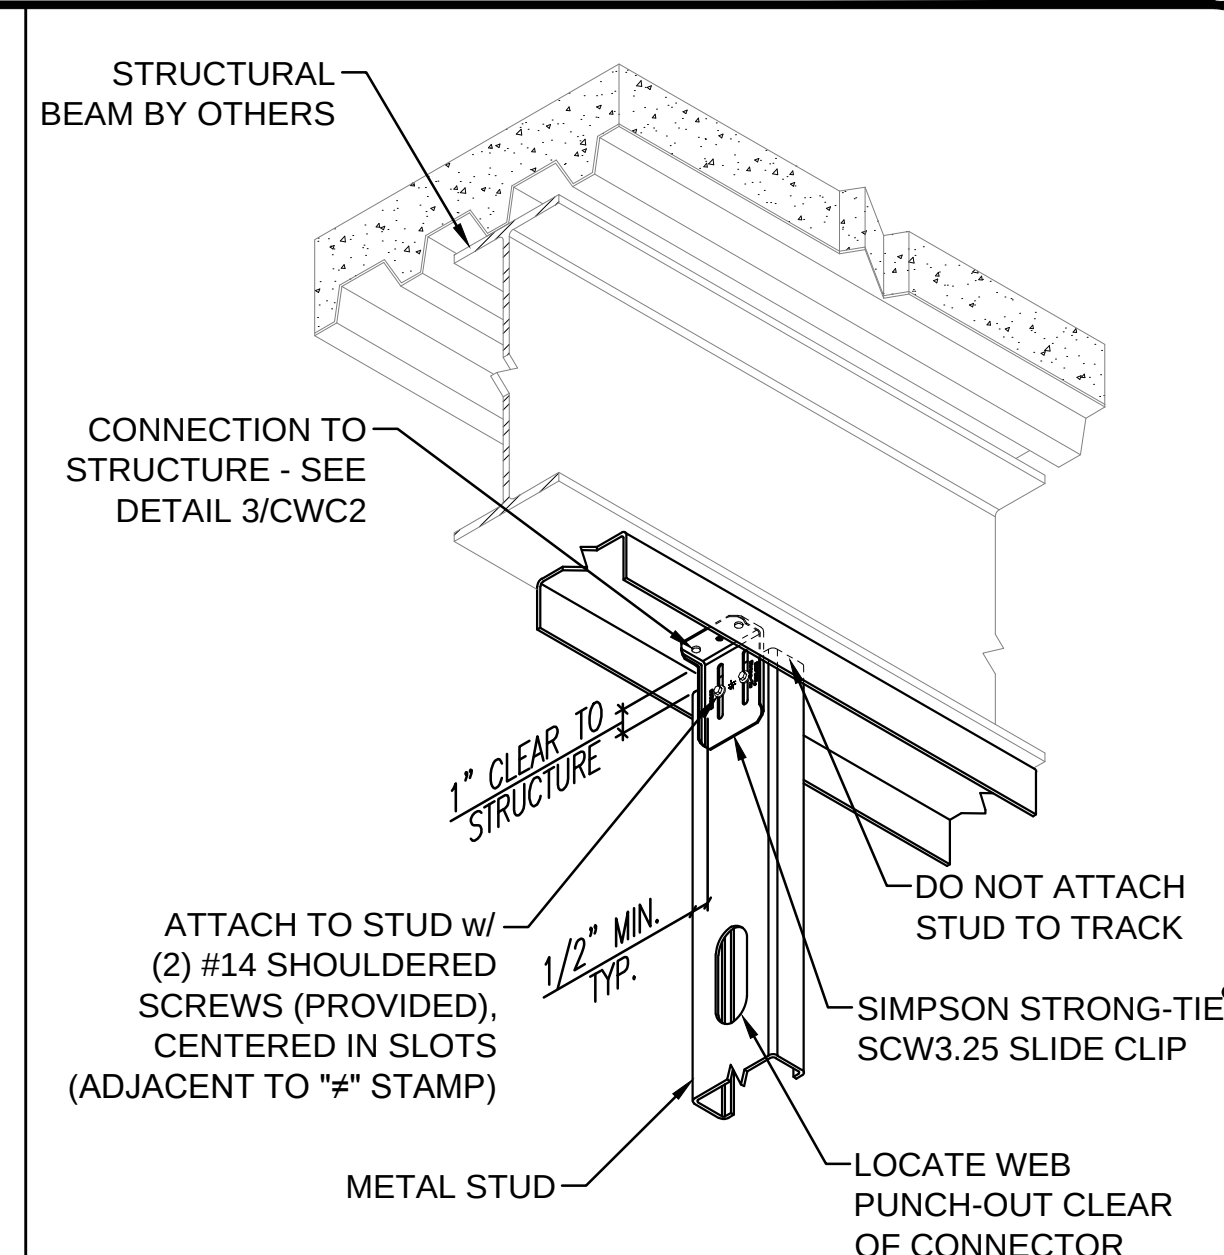

C SCW3.25 W/ (2) SCREWS

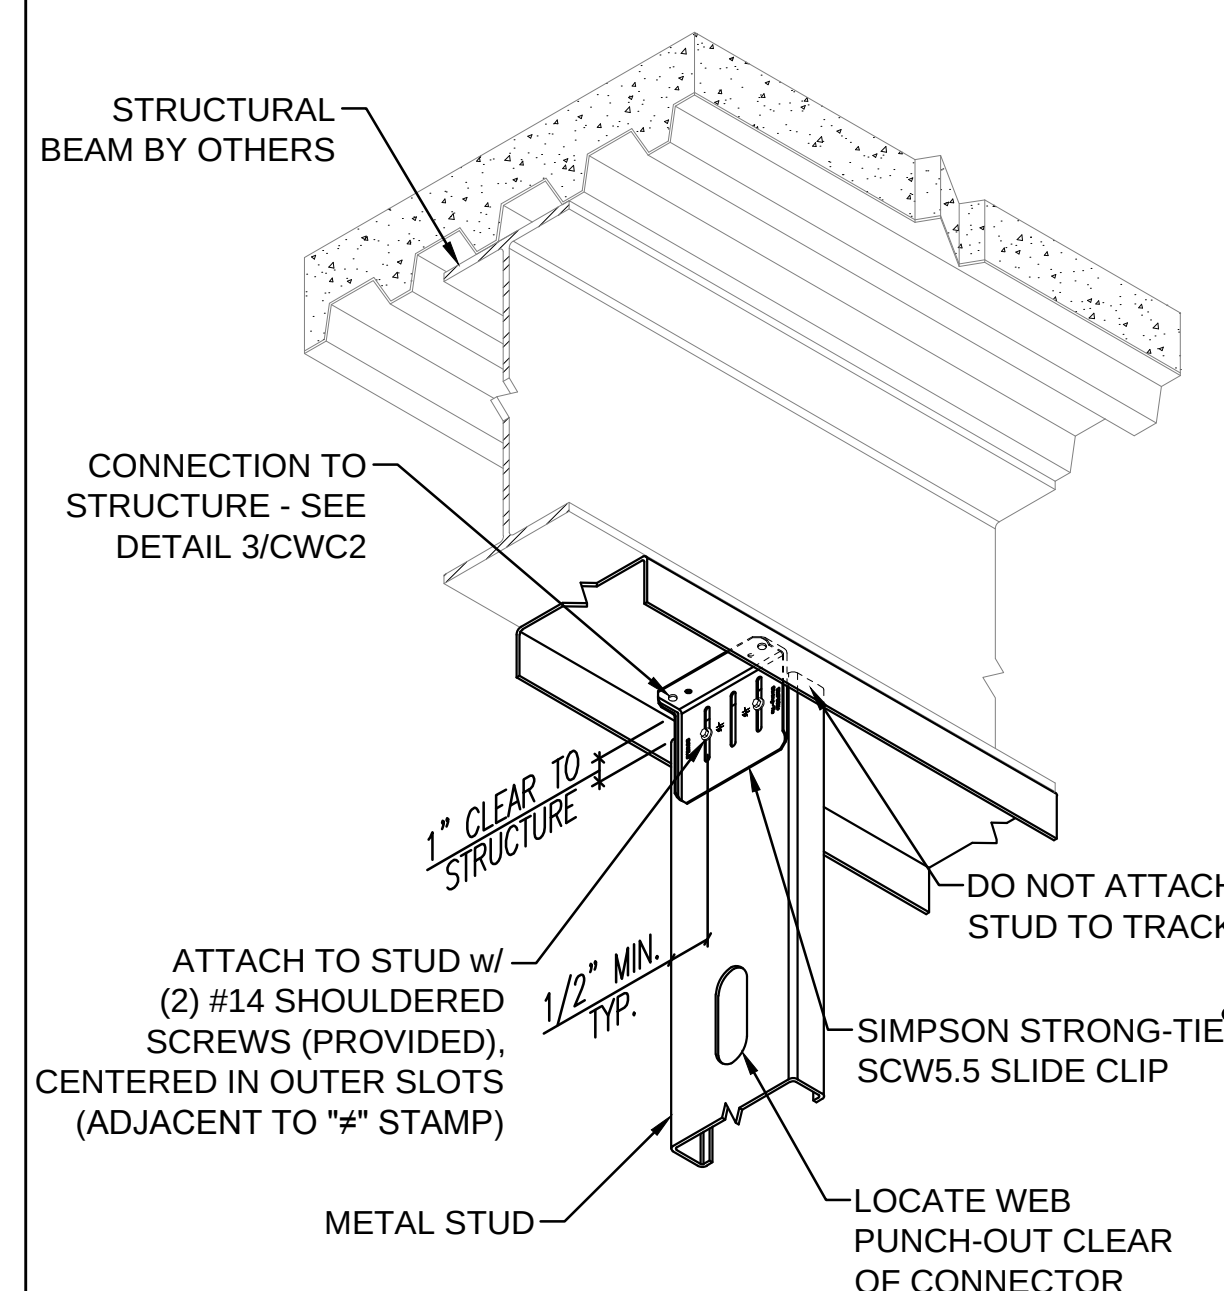

B SCW5.5 W/ (2) SCREWS

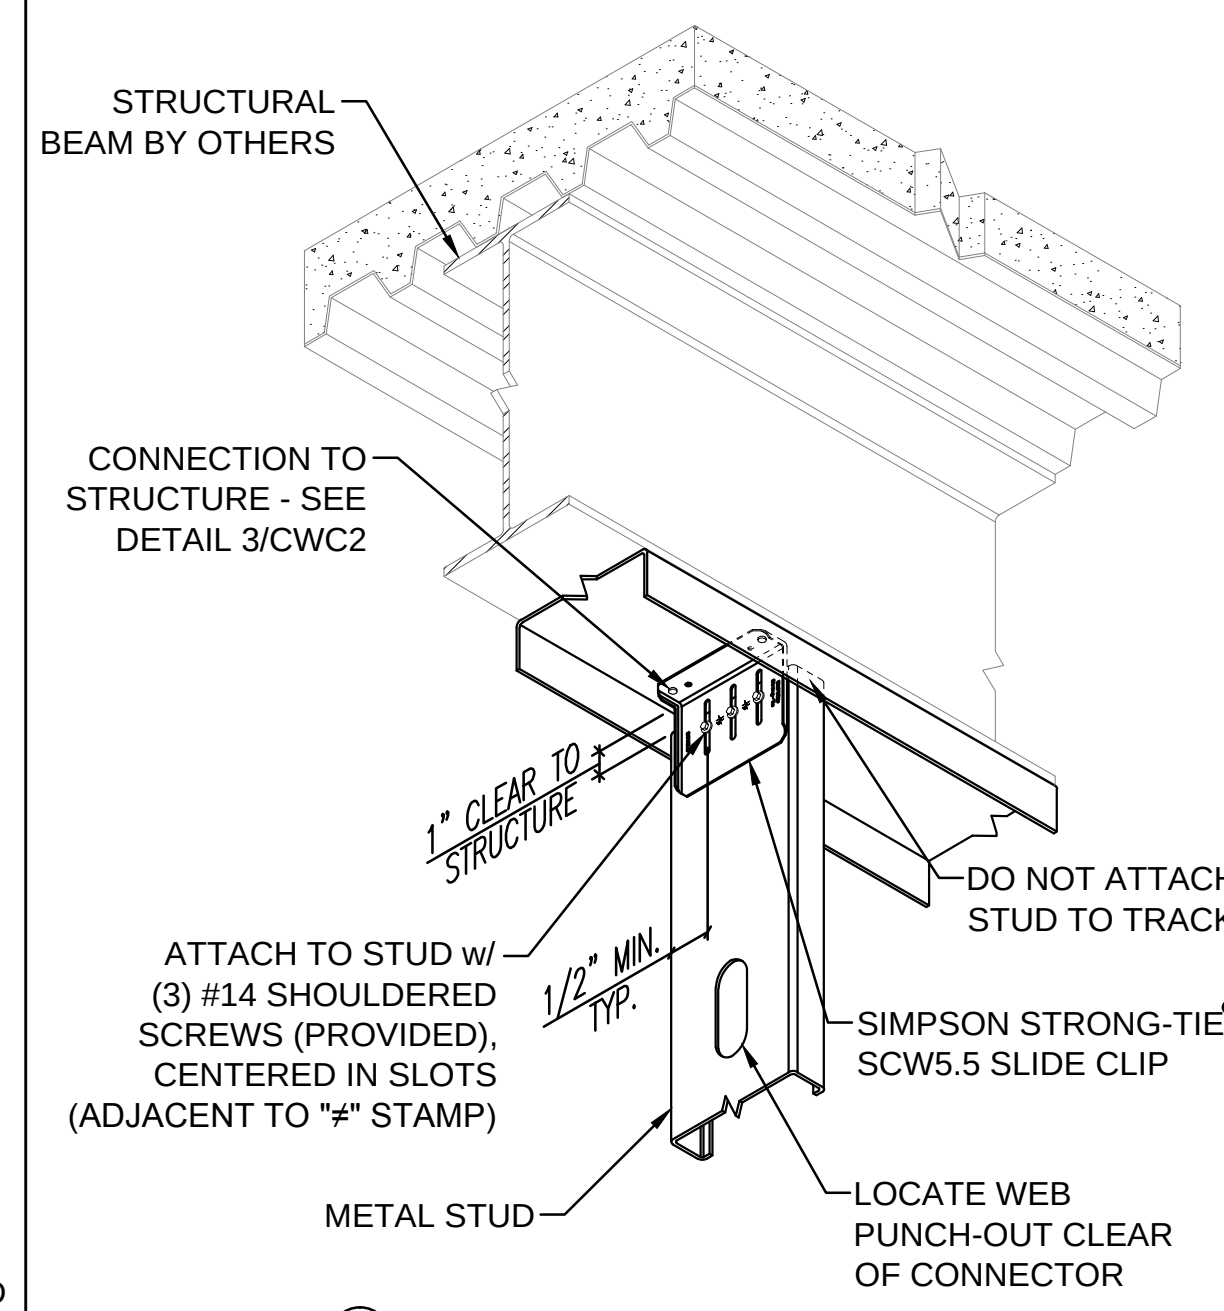


A SCW5.5 W/ (3) SCREWS

SCW HEAD-OF-WALL SLIDE CLIP

1

NO.	DATE	REVISIONS
1	4-10-12	FIRST RELEASE

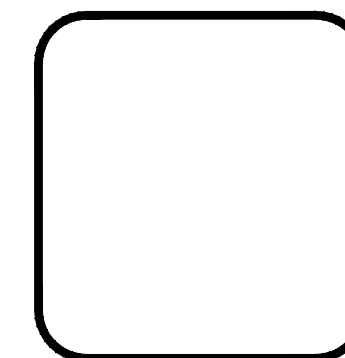

SIMPSON STRONG-TIE COMPANY, INC.
HOME OFFICE: POSITAS BLVD.
5956 WILSON RD., SUITE 500
LAS VEGAS, NV 89118
TEL: (800) 999-5099

CFS CURTAIN WALL
CONNECTORS
INSTALLATION DETAILS

NAME	
DATE	4-10-12
SCALE	N.T.S.
CHECKED	
SHEET	CWC2
OF SHEETS	
JOB NO.	