



MINIMUM SSTB ANCHOR REQUIREMENTS ^{1,2,4}	
WOOD STRONG-WALL MODEL	SLAB ON GRADE - GARAGE CURB (CORNER AND STEP - DOWN END)
SW16	SSTB28
SW22	
SW18	
SW24	SSTB28 ²
SW32	
SW48	

- NOTES:
- ADDITIONAL APPLICATIONS MAY USE THE SSTB WHERE THE DEMAND UPLIFT FORCE IS LESS THAN THE ALLOWABLE SSTB LOAD SHOWN IN ICC-ES ESR-2611.
 - SW18X8, SW24X8, SW32X8, SW48X8/10 UNDER SEISMIC LOADING MAY USE SSTB28 WITH NO LOAD REDUCTIONS. MAXIMUM UPLIFT FOR ALL OTHER MODELS SHALL BE LIMITED TO 10,085 LBS. (WIND AND SDC A&B), AND 8,475 LBS. (SDC C-F).
 - FOUNDATION DIMENSIONS ARE FOR ANCHORAGE ONLY. FOUNDATION DESIGN (SIZE AND REINFORCEMENT) BY OTHERS. THE REGISTERED DESIGN PROFESSIONAL MAY SPECIFY ALTERNATE EMBEDMENT, FOOTING SIZE OR ANCHOR BOLT.
 - SEE ICC-ES ESR-2611 FOR ADDITIONAL SSTB INFORMATION.


SSTB ANCHORAGE 1

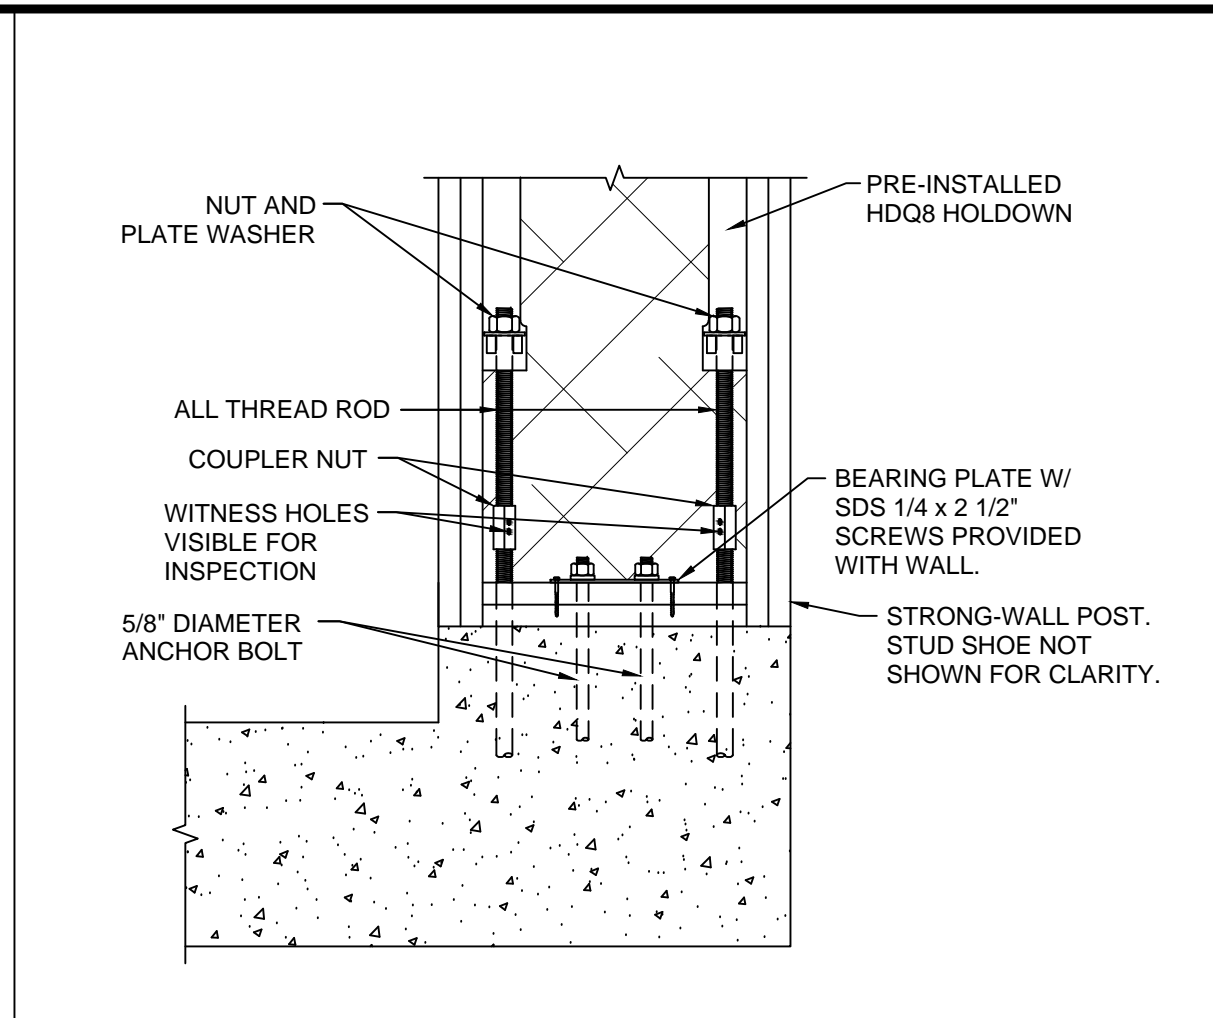


PORTAL WALL SILL 2

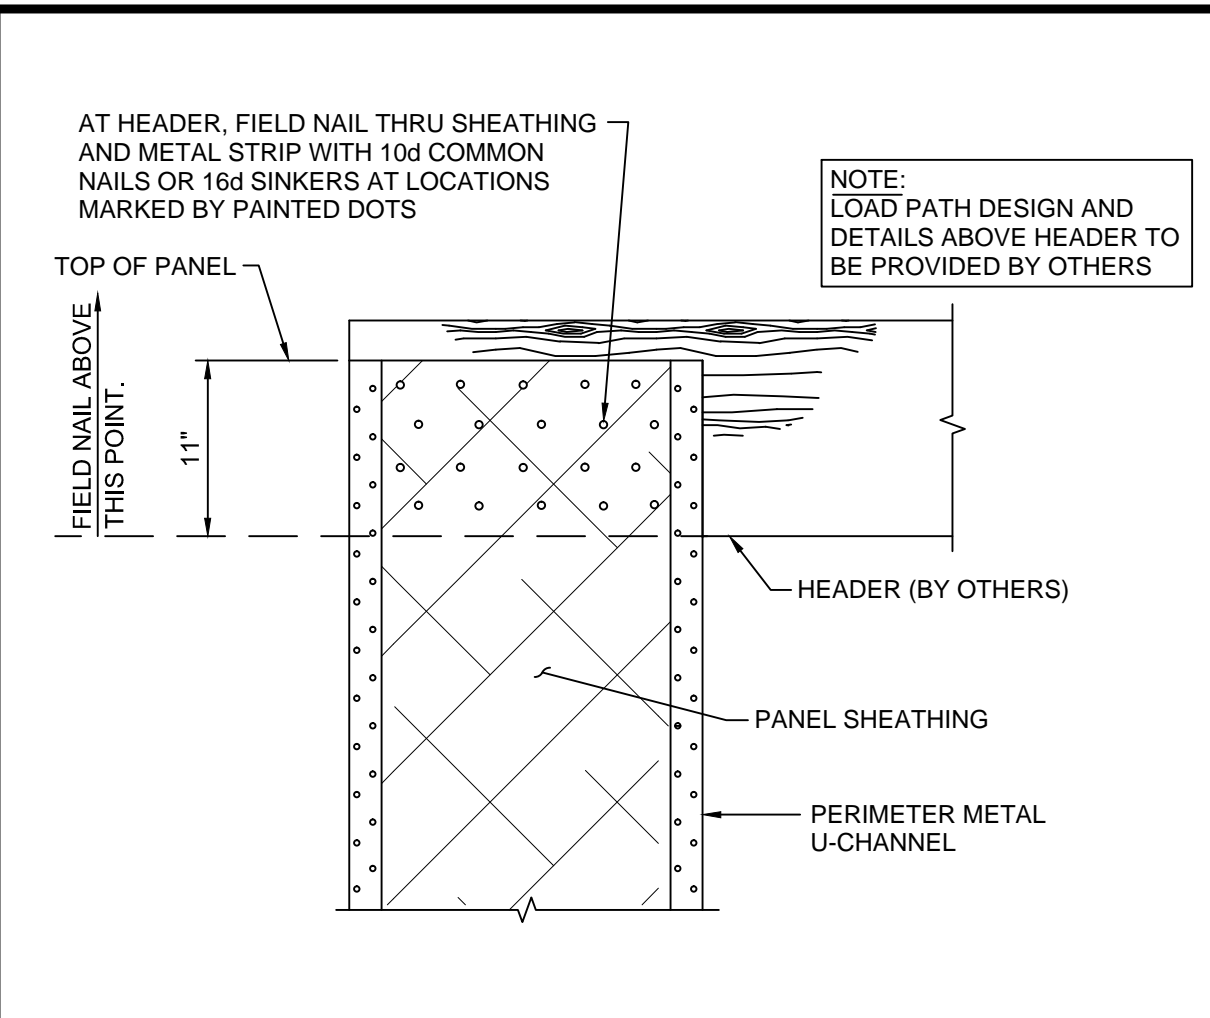


TOP OF WALL CONNECTION 3

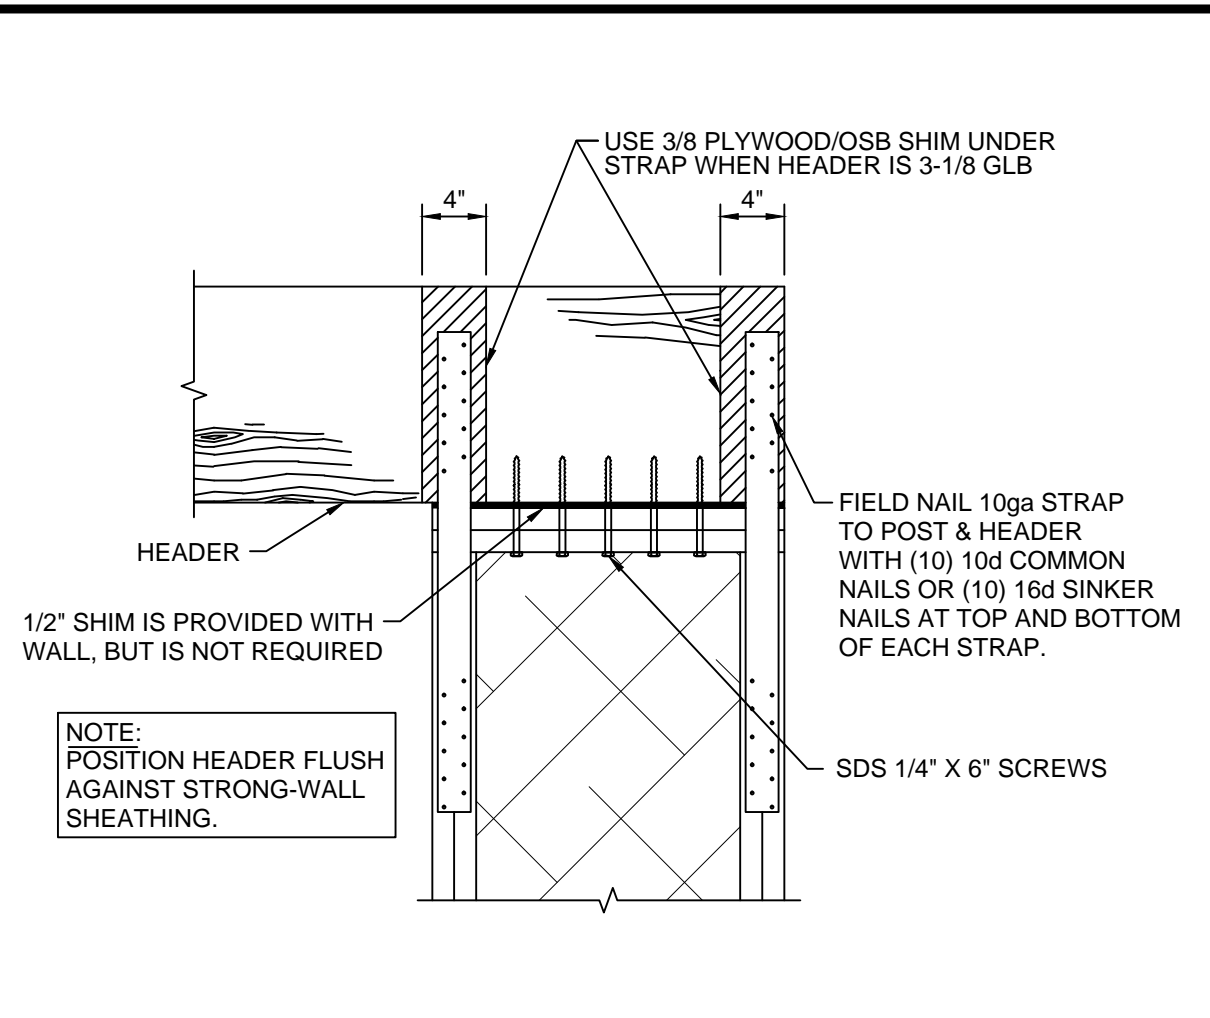


TOP OF WALL CONNECTION 4

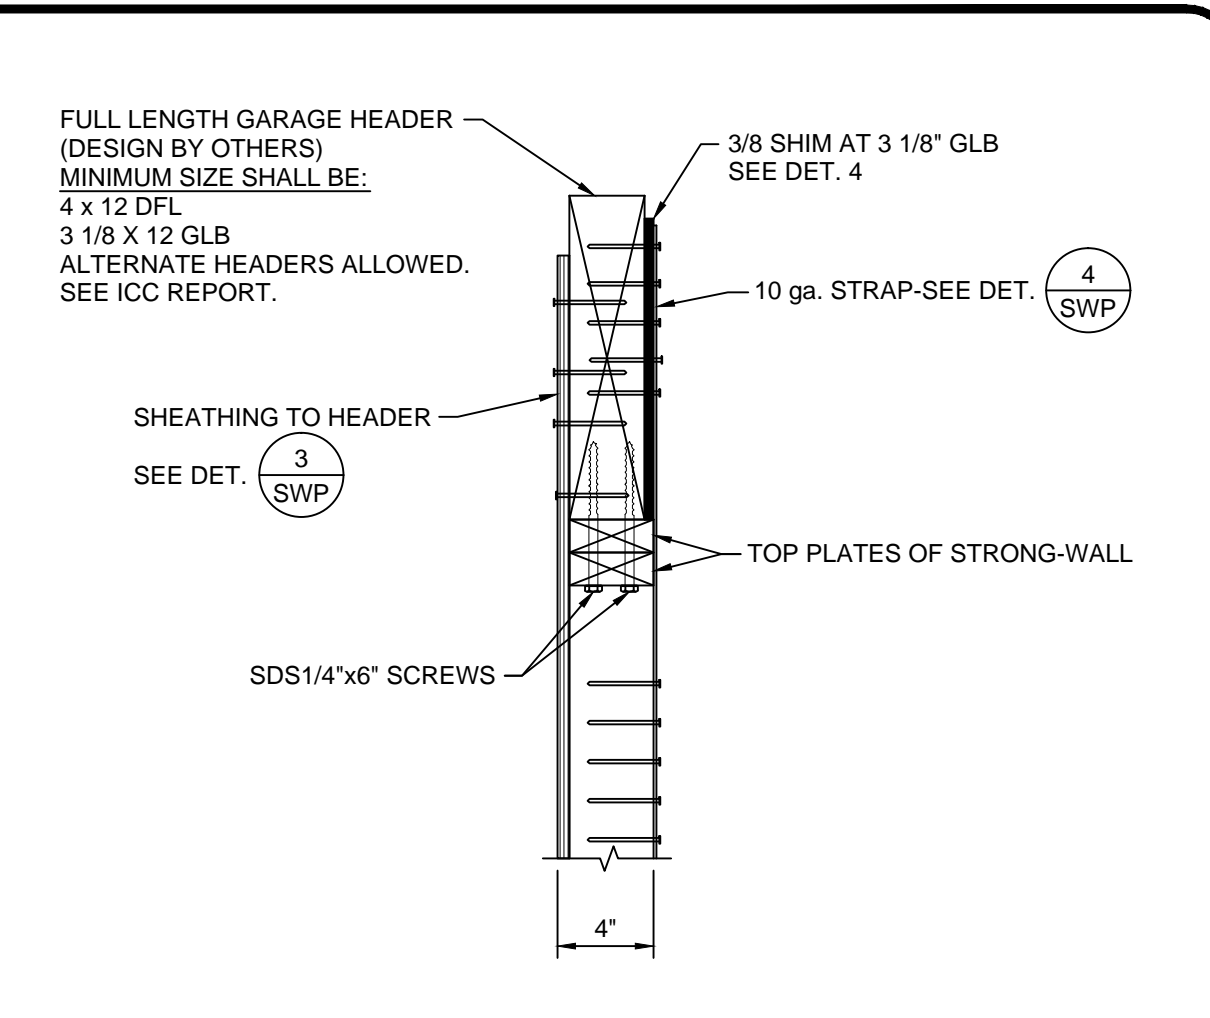


4" PORTAL WALL SECTION 5

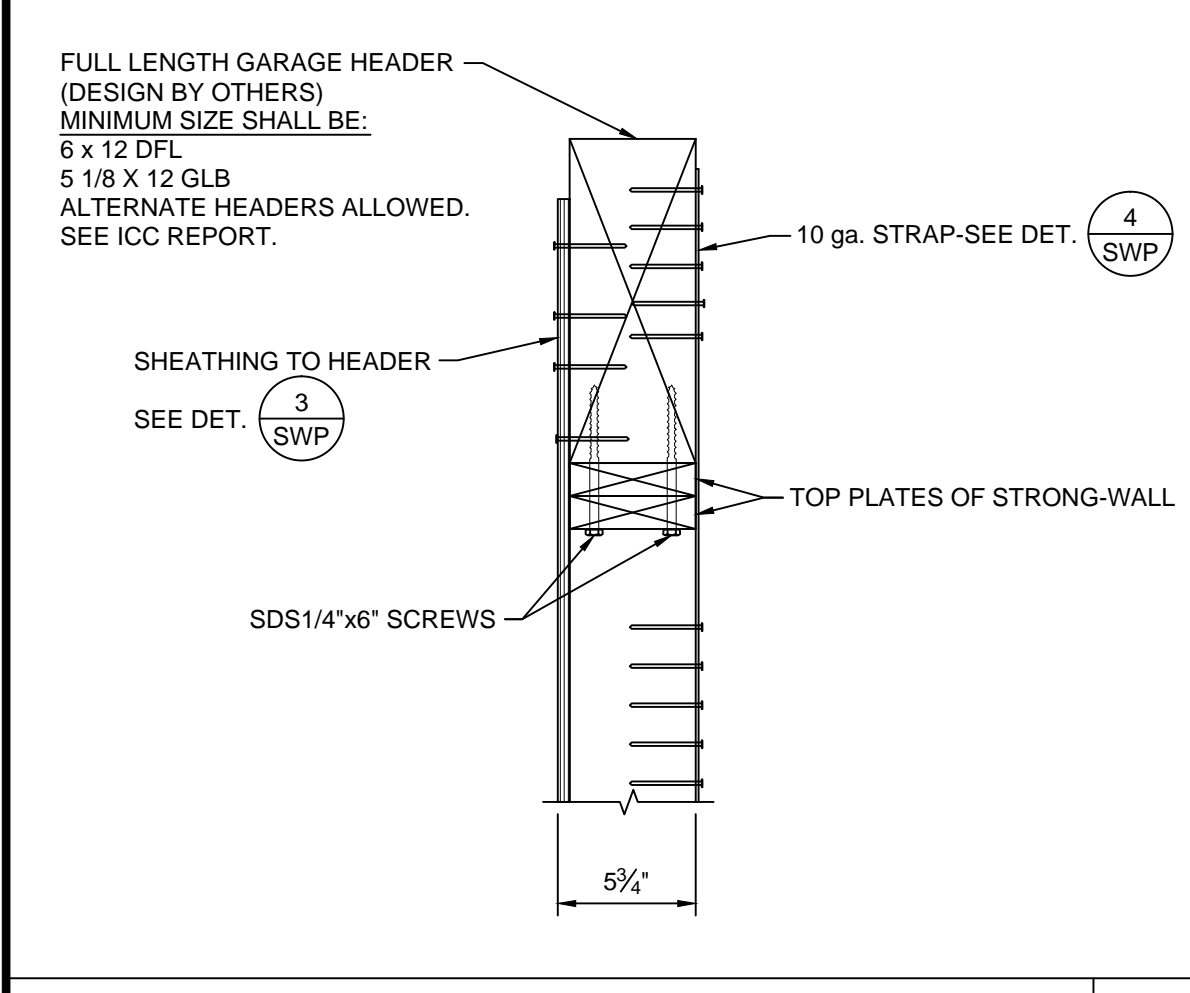


5.75" PORTAL WALL SECTION 6

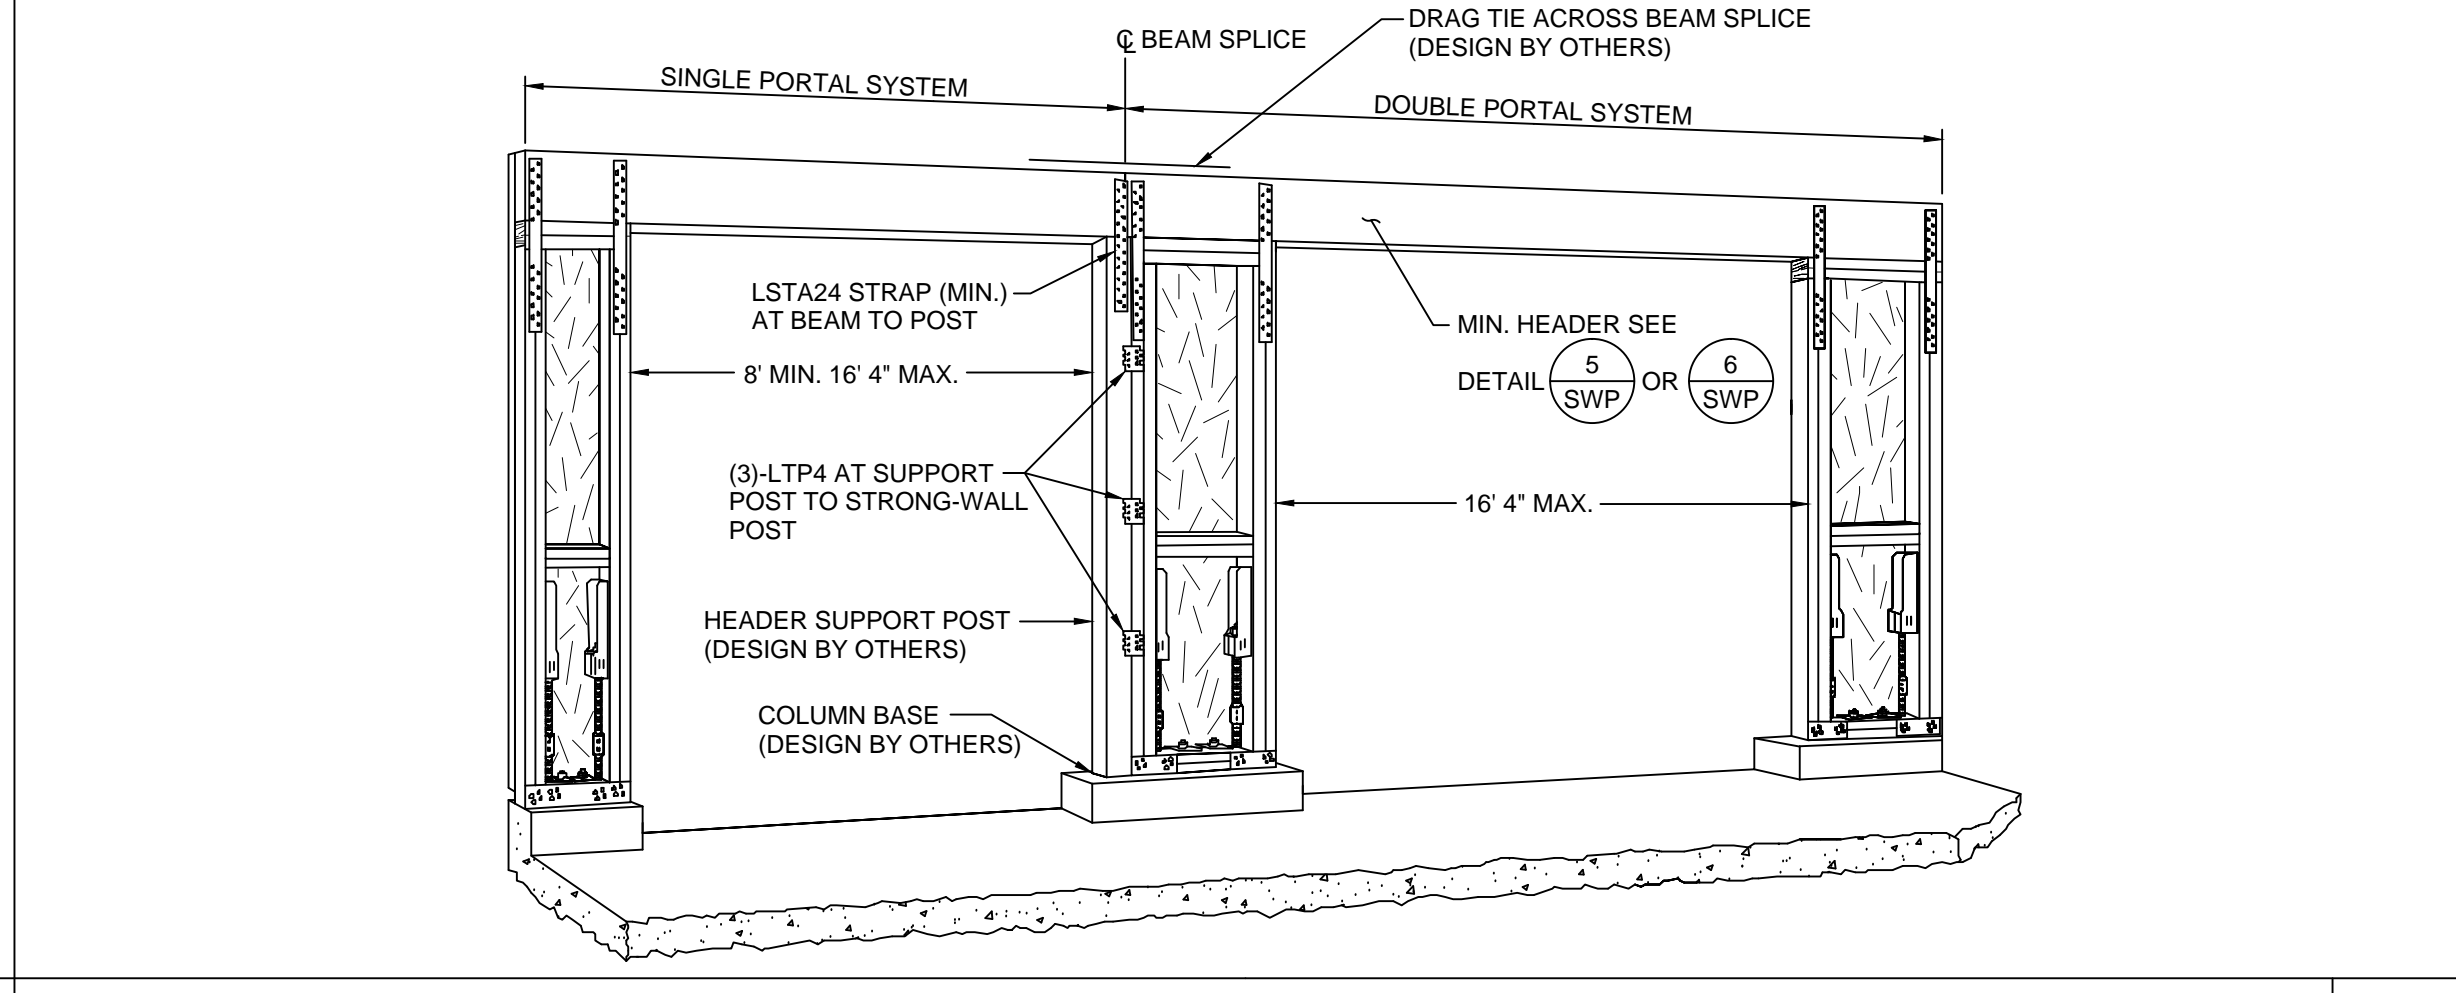


SINGLE & DOUBLE PORTAL ASSEMBLY 7

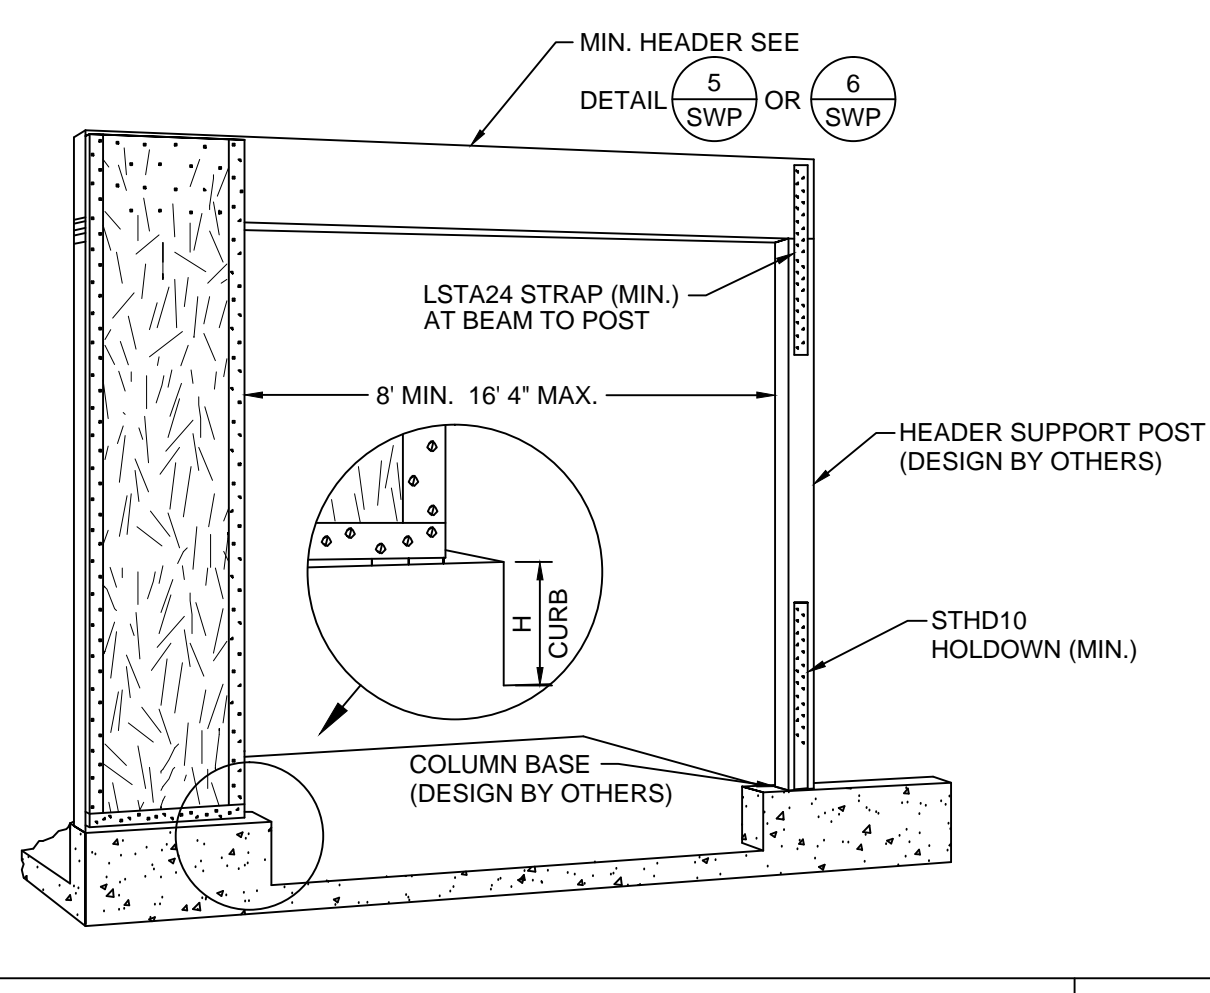

SINGLE PORTAL ASSEMBLY 8

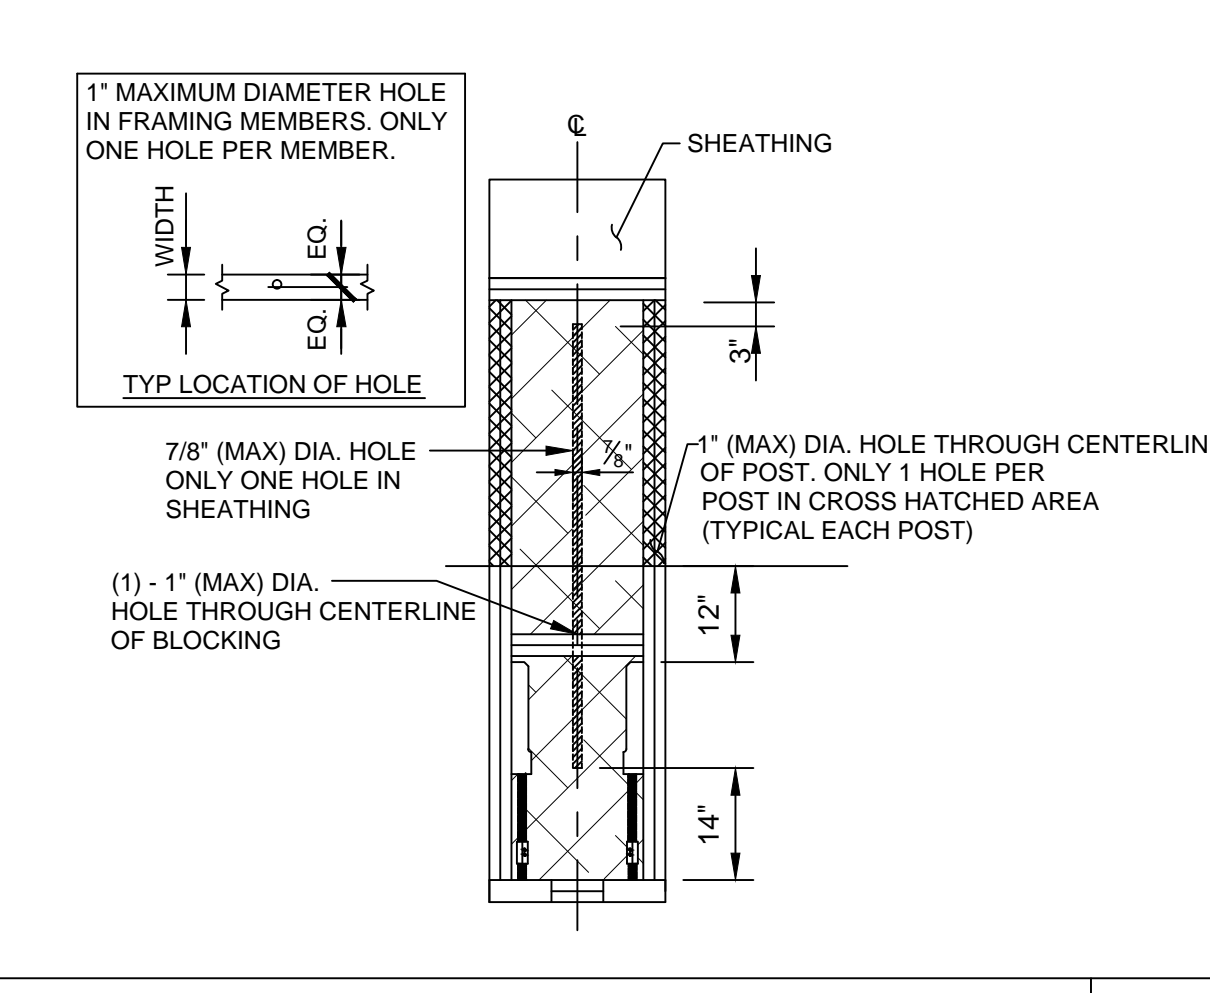


16" & 22" PORTAL WALL OPENINGS 9

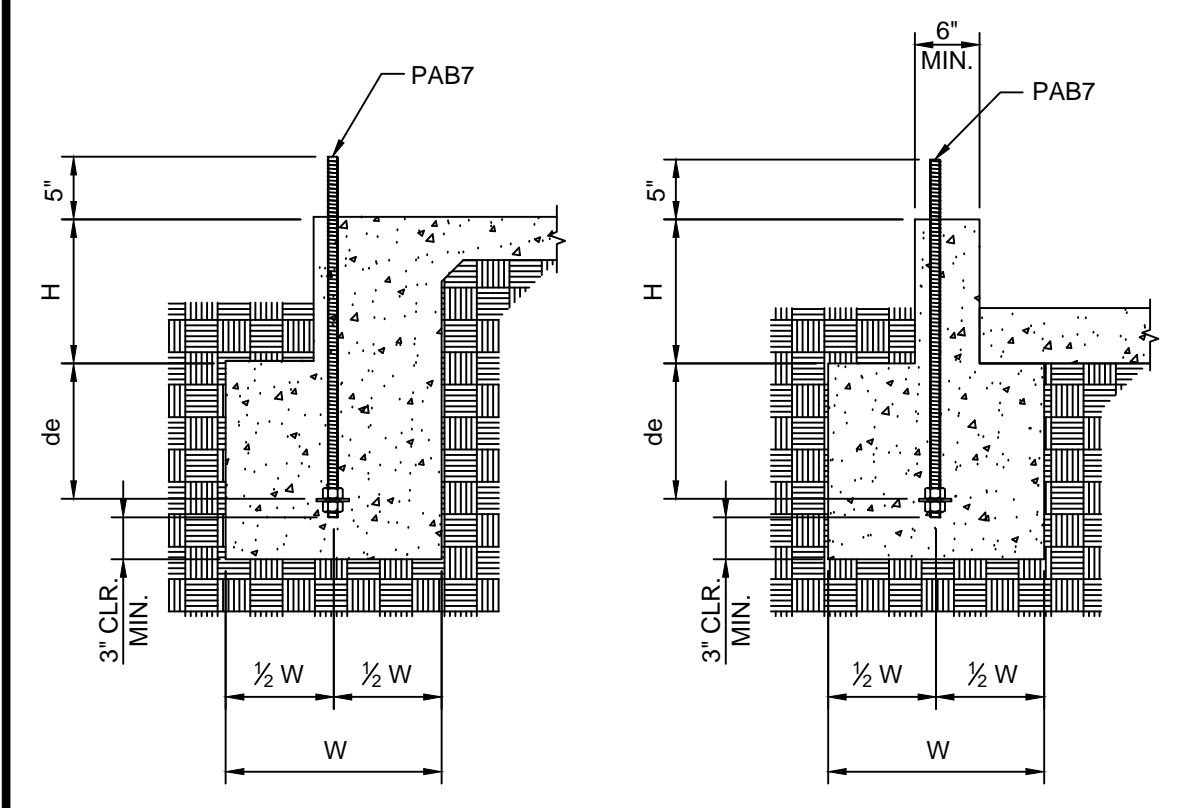


H = 13 1/2" MAXIMUM WITH PAB7-30 ANCHOR BOLT WHEN de = 10"
H = 19 1/2" MAXIMUM WITH PAB7-36 ANCHOR BOLT WHEN de = 10"

SLAB ON GRADE FOUNDATION CURB OR STEMWALL FOUNDATION

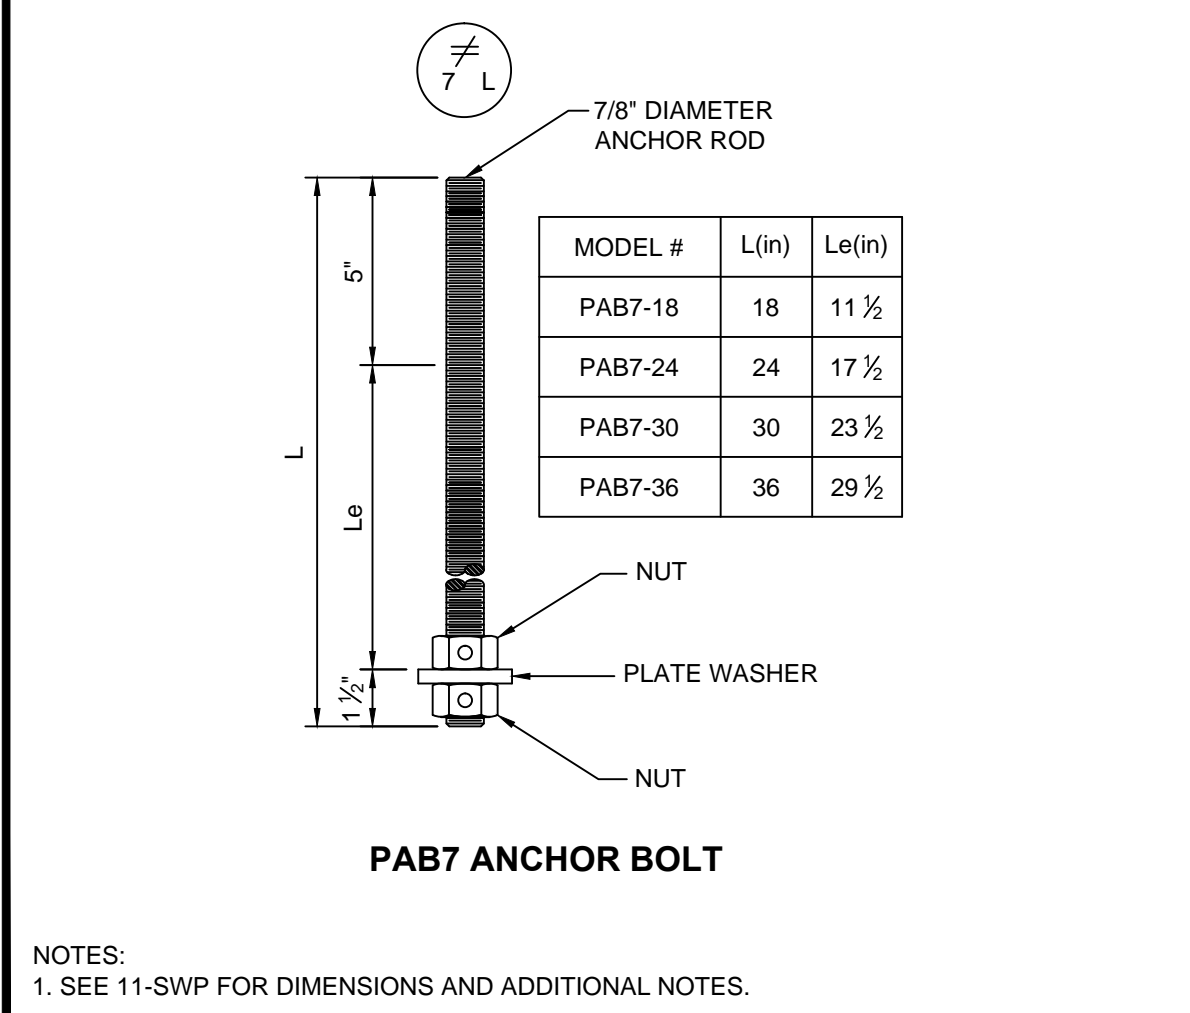

ANCHORAGE - TYPICAL SECTIONS 10



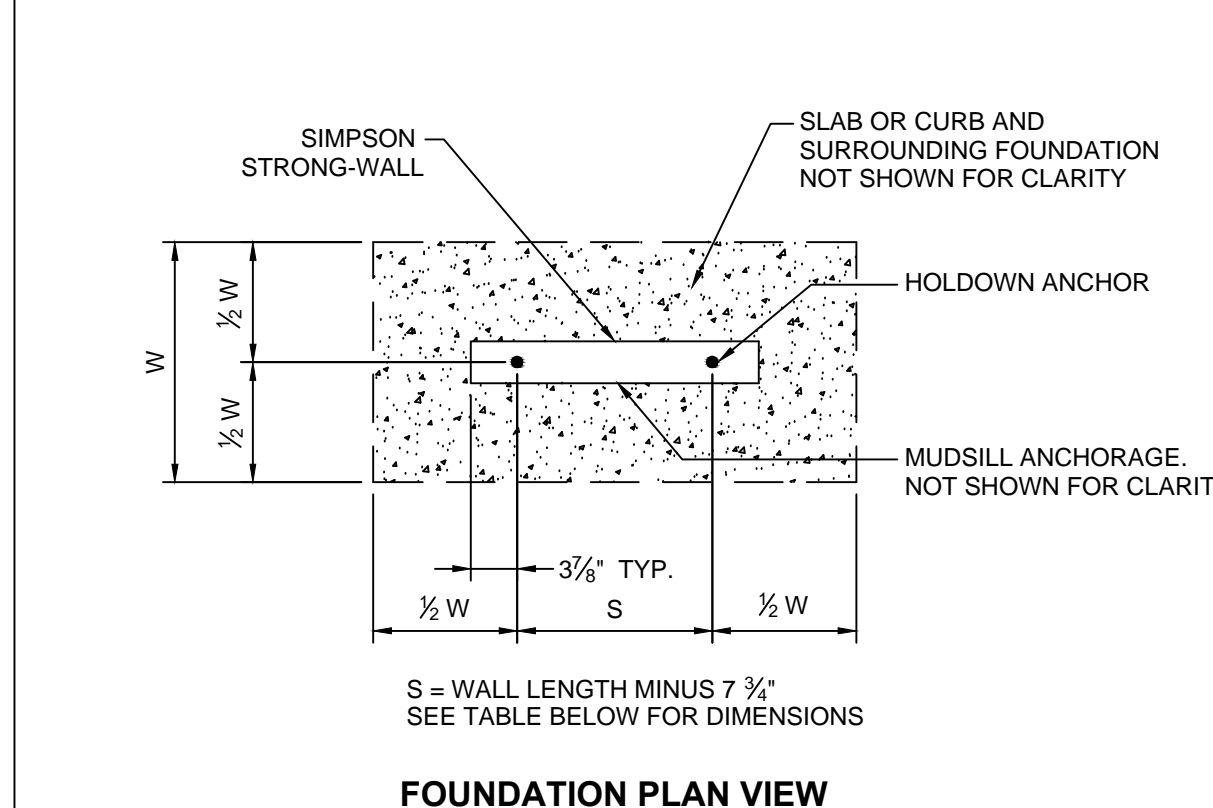


FOUNDATION PLAN VIEW


SEISMIC	CONDITION	FOUNDATION DIMENSIONS FOR STRONG-WALL ANCHORAGE		
		ASD ALLOWABLE UPLIFT (lbs)	W (in)	de (in)
CRACKED		11,900	27	9
		13,100	29	10
		12,500	24	8
		13,100	25	9
UNCRACKED		6,200	16	6
		10,000	22	8
		12,900	26	9
		13,100	27	9
WIND		6,400	14	6
		9,300	18	6
		12,500	22	8
		13,100	23	8

- NOTES:
- ANCHORAGE DESIGNS CONFORM TO ACI 318-11 APPENDIX D AND ASSUME MINIMUM $f_c=2,500$ PSI CONCRETE, ASTM A307 OR ASTM F1554, GRADE 36 ANCHOR RODS AND NO SUPPLEMENTARY REINFORCEMENT. HIGH STRENGTH ANCHORAGE DESIGN BY OTHERS WHEN REQUIRED.
 - SEISMIC INDICATES SEISMIC DESIGN CATEGORY C THROUGH F. DETACHED 1 AND 2 FAMILY DWELLINGS IN SDC C MAY USE WIND ANCHORAGE SOLUTIONS. SEISMIC ANCHORAGE DESIGNS CONFORM TO ACI 318-11 SECTION D.3.3.4.
 - WIND INCLUDES SEISMIC DESIGN CATEGORY A AND B.
 - FOUNDATION DIMENSIONS ARE FOR ANCHORAGE ONLY. FOUNDATION DESIGN (SIZE AND REINFORCEMENT) BY OTHERS. THE REGISTERED DESIGN PROFESSIONAL MAY SPECIFY ALTERNATE EMBEDMENT, FOOTING SIZE OR ANCHOR BOLT.
 - FOR ANCHORAGE SOLUTIONS USING SSTB, SEE ICC-ES ESR-2611.

ANCHORAGE SCHEDULE 11

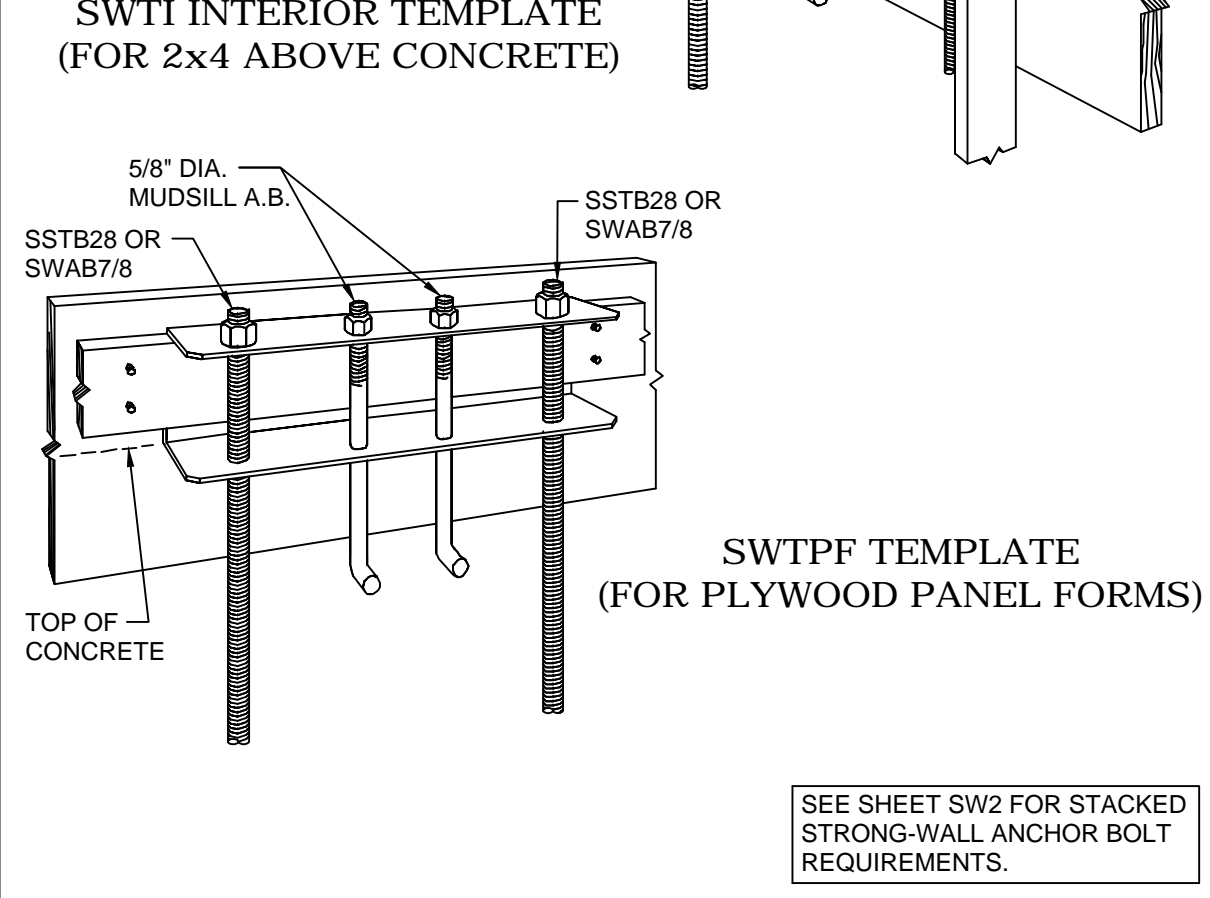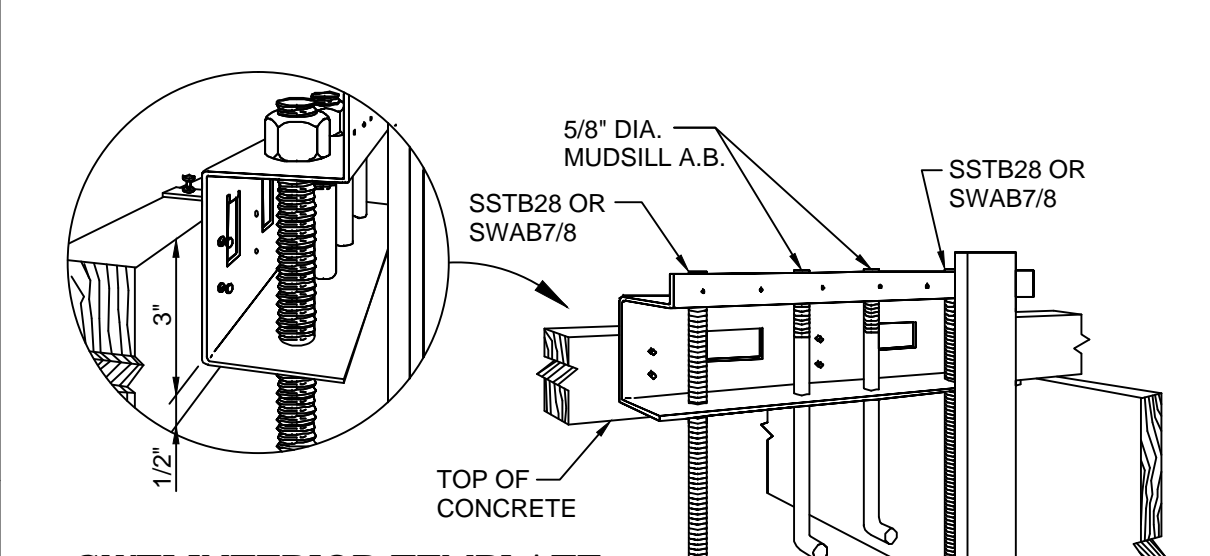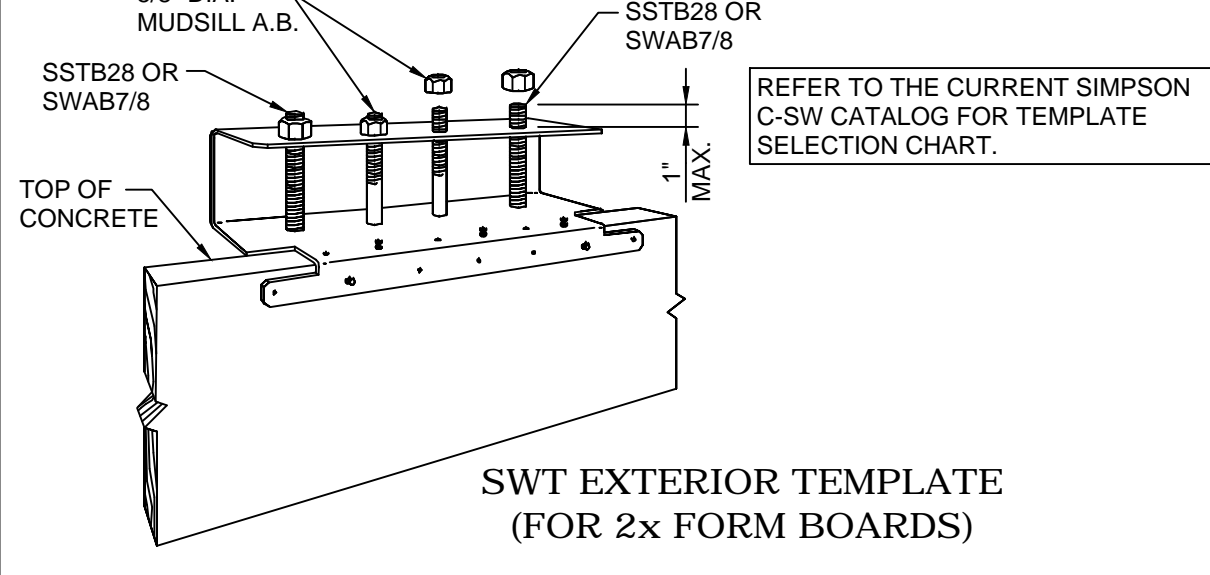


STRONG-WALL® TEMPLATES 12

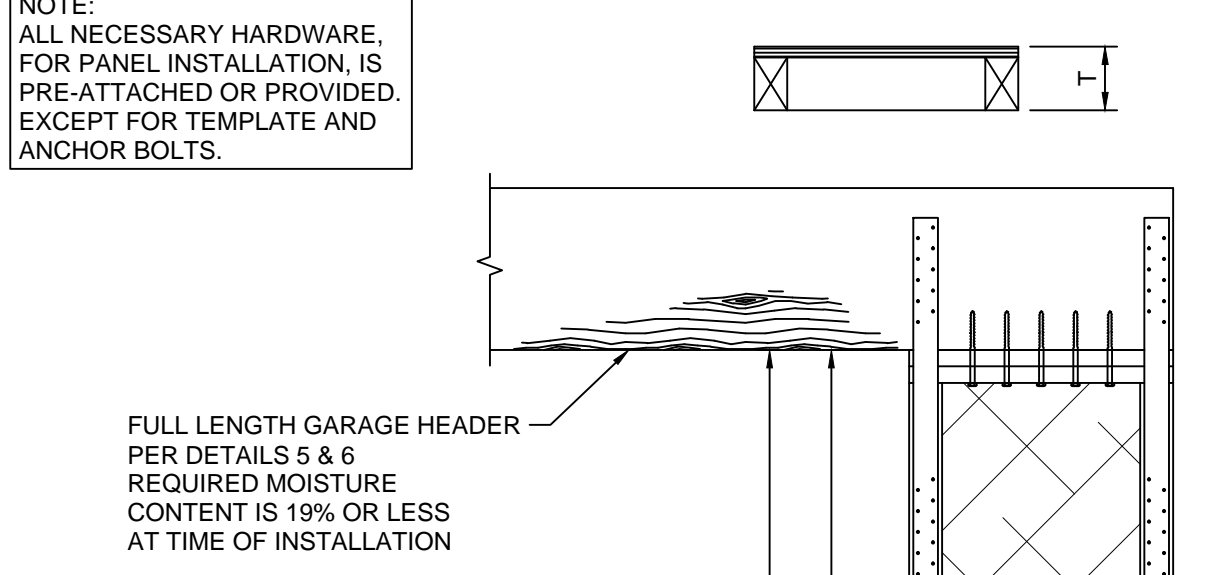

MODEL	GARAGE HEADER ROUGH OPENING HEIGHT		
	H CURB	W/O SHIM ¹	WITH SHIM ¹
SW16x7x4	6"	7'-0"	7'-0 1/2"
SW16x7x6			
SW22x7x4	7"	7'-1"	7'-1 1/2"
SW22x7x6			
SW16x8x4	6"	8'-0"	8'-0 1/2"
SW16x8x6			
SW22x8x4	7"	8'-1"	8'-1 1/2"
SW22x8x6			

MODEL SET UP	W (IN)	H (IN)	T (IN)	GARAGE PORTAL WALL TABLE		ASSEMBLED WALL WEIGHT (lbs)
				NUMBER OF FASTENERS IN BOTTOM OF WALL	NUMBER OF MUDDL ANCHORS	
SW16x7x4	16	78	4	8-SDS 1/4x6	2-5/8"Ø	90
SW16x7x6	16	78	5 3/4	8-SDS 1/4x6	2-5/8"Ø	112
SW16x8x4	16	90	4	8-SDS 1/4x6	2-5/8"Ø	95
SW16x8x6	16	90	5 3/4	8-SDS 1/4x6	3-5/8"Ø	120
SW22x7x4	22	78	4	10-SDS 1/4x6	2-5/8"Ø	95
SW22x7x6	22	78	5 3/4	10-SDS 1/4x6	2-5/8"Ø	117
SW22x8x4	22	90	4	10-SDS 1/4x6	2-5/8"Ø	105
SW22x8x6	22	90	5 3/4	10-SDS 1/4x6	2-5/8"Ø	130

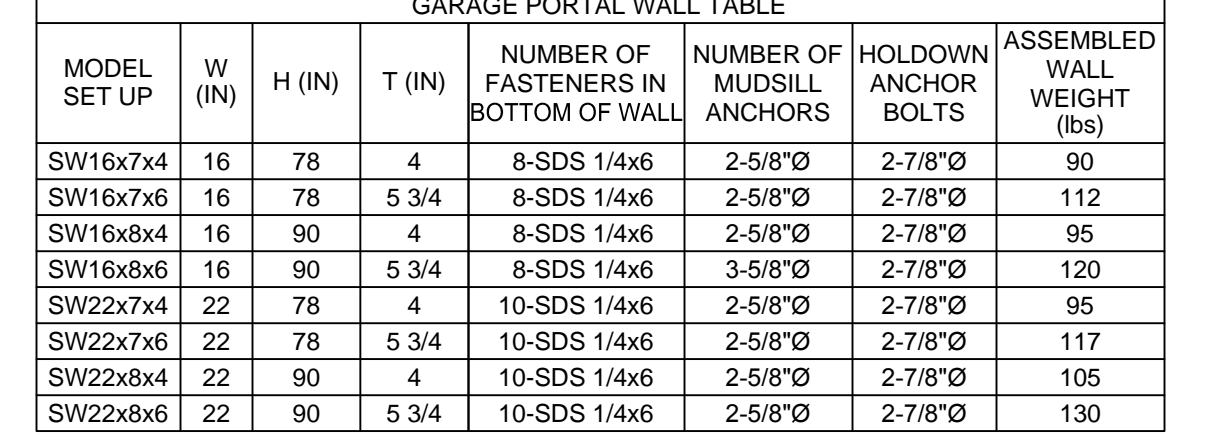


PORTAL WALL SPECIFICATIONS 13

- STRONG-WALL® SHEARWALL IS MANUFACTURED AND TRADEMARKED BY "SIMPSON STRONG-TIE COMPANY INC.". HOME OFFICE: 5956 W. LAS POSITAS BOULEVARD, PLEASANTON, CA. 94588 TEL: (800) 999-5099, FAX: (925) 875-0826 *SIMPSON STRONG-TIE COMPANY INC.* IS AN ISO 9001 REGISTERED COMPANY.
- INSTALLATION OF PRODUCT SHALL BE DONE IN STRICT CONFORMANCE TO THESE DRAWINGS AND THE STRONG-WALL® INSTALLATION GUIDE. MODIFICATIONS TO THIS PRODUCT AND ASSOCIATED SYSTEMS OR CHANGES IN THE INSTALLATION METHODS SHOWN ON THESE DRAWINGS AND THE INSTALLATION GUIDE SHOULD ONLY BE MADE BY A QUALIFIED ARCHITECT, CIVIL, OR STRUCTURAL ENGINEER. THE PERFORMANCE OF SUCH MODIFIED PRODUCTS OR ALTERED INSTALLATION PROCEDURES IS THE SOLE RESPONSIBILITY OF THE DESIGNER. REFER TO ICC-ES ESR-1267 FOR FURTHER INFORMATION.
- THE CONTRACTOR SHALL VERIFY ALL DIMENSIONS, CONDITIONS, ELEVATIONS, ETC. PRIOR TO INSTALLATION OF ANY COMPONENTS FOR THE STRONG-WALL® SYSTEM. IF ANY DISCREPANCIES ARE FOUND, THEY SHALL BE BROUGHT TO THE ATTENTION OF THE PROJECT ARCHITECT, PROJECT ENGINEER OR BUILDING DESIGNER FOR CLARIFICATION PRIOR TO CONSTRUCTION.
- THE CONTRACTOR SHALL VERIFY THE POSITION OF THE STRONG-WALL IN RELATION TO THE REST OF THE BUILDING SYSTEM AS SHOWN ON THE PROJECT DRAWINGS.
- USE OF THIS PRODUCT IS SUBJECT TO THE APPROVAL OF THE LOCAL BUILDING OFFICIAL.
- THE BUILDING STRUCTURE SHALL BE DESIGNED IN ACCORDANCE WITH THE LATEST ADOPTE VERSION OF THE BUILDING CODE AND ANY OTHER LOCAL, STATE OR FEDERAL REQUIREMENTS THAT MAY APPLY. VERIFY DESIGN REQUIREMENTS WITH THE LOCAL BUILDING DEPARTMENT.
- THIS PRODUCT IS PART OF THE OVERALL LATERAL FORCE RESISTING SYSTEM OF THE STRUCTURE. DESIGN OF THE BUILDING'S LATERAL FORCE RESISTING SYSTEM, INCLUDING A COMPLETE LOAD PATH NECESSARY TO TRANSFER LATERAL FORCES FROM THE STRUCTURE TO THE GROUND, IS THE RESPONSIBILITY OF THE DESIGNER.
- SIMPSON STRONG-TIE COMPANY INC. RESERVES THE RIGHT TO CHANGE SPECIFICATIONS, DESIGNS AND MODELS WITHOUT NOTICE OR LIABILITY FOR SUCH CHANGES.
- ALL HARDWARE CALLED OUT IS SIMPSON STRONG-TIE.®

NOTES 14

NO.	DATE	REVISIONS
1	05/04/07	GENERAL REVISIONS
2	09/23/07	GENERAL REVISIONS
3	08/29/08	ESR-1267 REVISIONS
4	02/22/11	ESR-2611 REVISIONS
5	07/11/13	2012 IBC REVISIONS

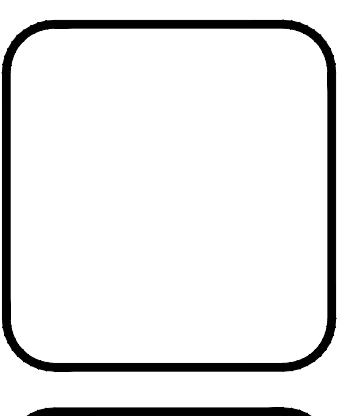

SIMPSON STRONG-TIE COMPANY INC.
HOME OFFICE: 5956 W. LAS POSITAS BLVD., PLEASANTON, CA 94588
Tel: (800) 999-5099 Fax: (925) 875-0826
THERE IS NO EQUAL

STRONG-WALL®
PORTAL WALLS
THERE IS NO EQUAL

NAME	
DATE	7-11-2013
SCALE	N.T.S.
CHECKED	
SHEET	SWP
OF SHEETS	
JOB NO.	